

CAPITAL REGIONAL DISTRICT - INFRASTRUCTURE & WATER SERVICES**Water Watch**

Issued July 06, 2026

Water Supply System Summary:**1. Useable Volume in Storage:**

Reservoir	June 30 5 Year Ave		June 30/25		July 5/26		% Existing Full Storage
	ML	MIG	ML	MIG	ML	MIG	
Sooke	82,518	18,154	79,837	17,564	77,593	17,070	83.7%
Goldstream	9,086	1,999	8,928	1,964	8,716	1,918	87.9%
Total	91,604	20,153	88,765	19,528	86,309	18,988	84.1%

2. Average Daily Demand:

For the month of June	197.4 MLD	43.4 MIGD
For week ending July 05, 2026	193.3 MLD	42.5 MIGD
Max. day June 2026, to date:	234.6 MLD	51.6 MIGD

3. Average 5 Year Daily Demand for June

Average (2021 - 2025)	184.1 MLD ¹	40.5 MIGD ²
	¹ MLD = Million Litres Per Day	² MIGD = Million Imperial Gallons Per Day

4. Rainfall June:

Average (1914 - 2025):	21.9 mm
Actual Rainfall to Date	23.7 mm (108% of monthly average)

5. Rainfall: Sep 1- Jul 5

Average (1914 - 2025):	1,586.1 mm
2025/2026	1,640.1 mm (103% of average)

6. Water Conservation Required Action:

Did you know that the 2024 change to the Water Conservation Bylaw recommends that landowners and residents switch timing of residential irrigation systems from 4:00 am to an expanded window anytime between 12:01 am to 10:00 am on established watering days? Please go to Water Conservation Bylaw Changes | Capital Regional District to get informed and do your part to help protect our regional water supply system.

<https://www.crd.ca/news/water-conservation-bylaw-changes>

For general information regarding water conservation, visit the CRD webpage linked below:
<https://www.crd.ca/environment/water-conservation>

If you require further information, please contact:

Alicia Fraser, P. Eng.
 General Manager, CRD - Infrastructure and Water Services
 or
 Glenn Harris, Ph D., RPBio
 Senior Manager - Environmental Protection

CRD Infrastructure & Water Services
 479 Island Highway
 Victoria, BC V9B 1H7
 (250) 474-9600


Daily Consumption

June 2026

Average Daily Consumption = 197.4 M.L.

2026 Actual Daily Consumption
5 Year Average Daily Consumption for the Month
2025 Average Daily Consumption for the Month

Consumption (Million Litres)

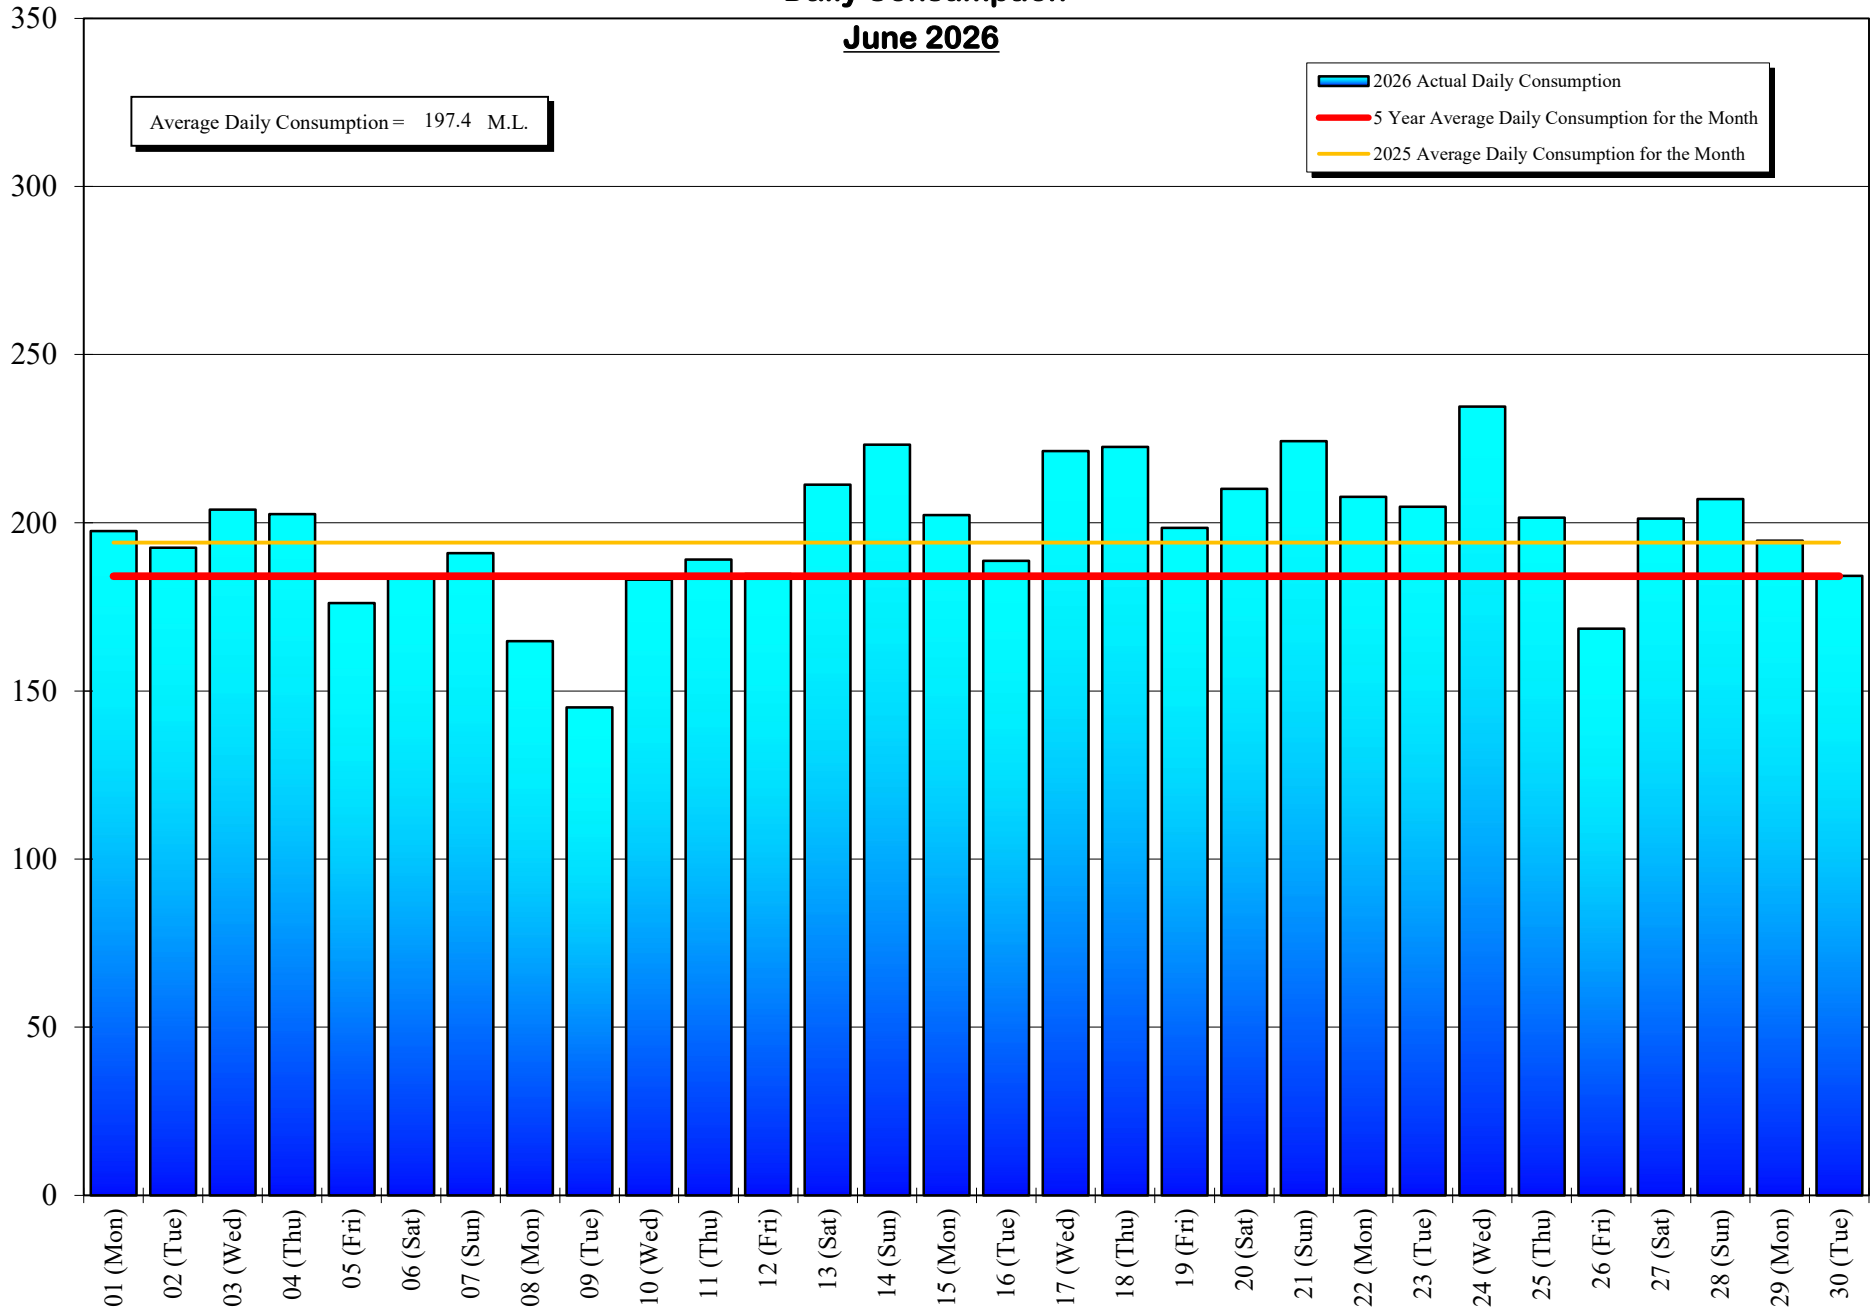

Day

Daily Consumption


July 2026

Average Daily Consumption = 194.8 M.L.

2026 Actual Daily Consumption
5 Year Average Daily Consumption for the Month
2025 Average Daily Consumption for the Month

Consumption (Million Litres)

Day

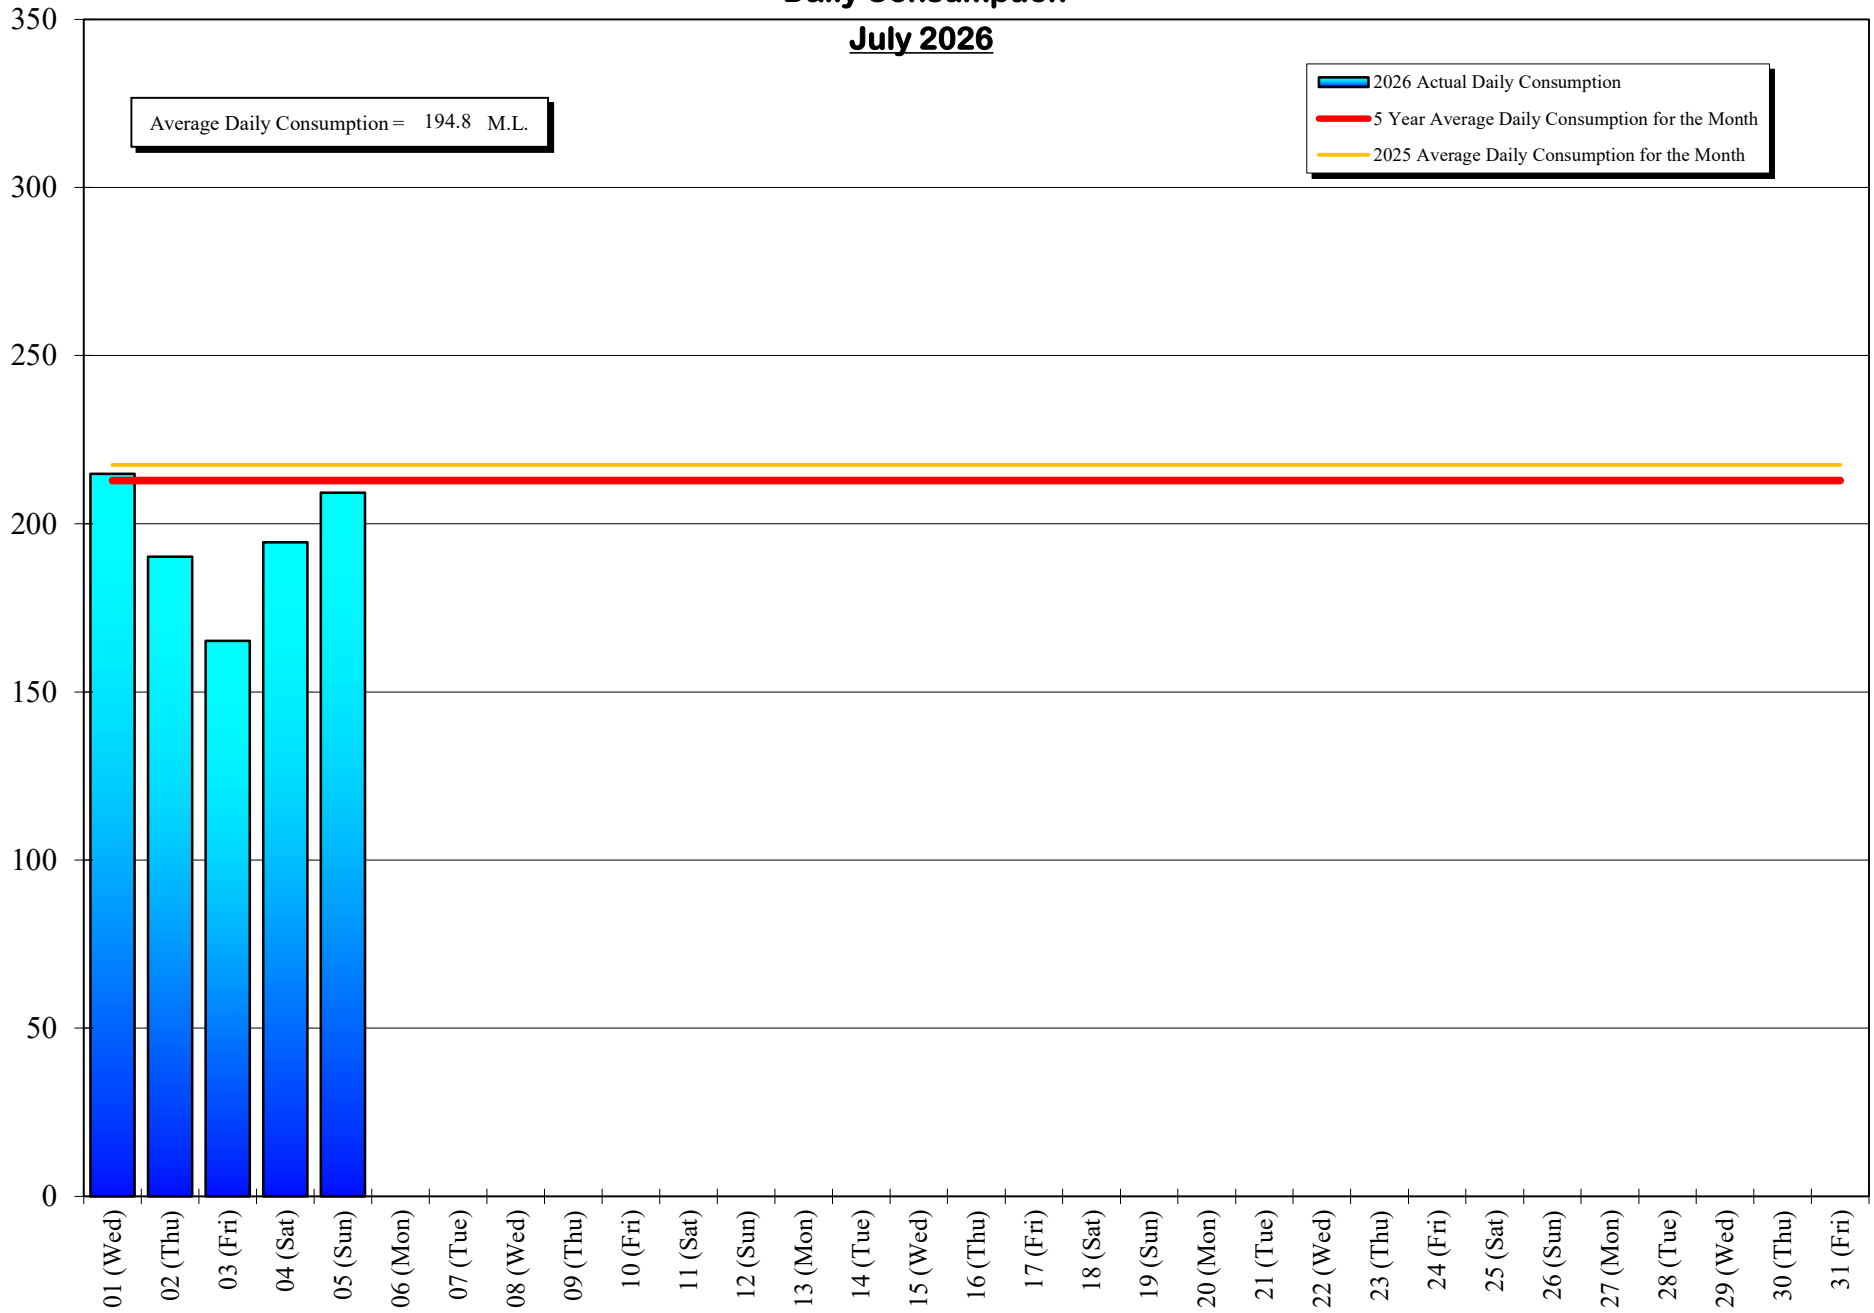

Daily Consumptions: - June 2026

Date	Total Consumption		Air Temperature @ Japan Gulch		Weather Conditions	Precipitation @ Sooke Res.: 12:00am to 12:00am		
	(ML) ¹	(MIG) ²	High (°C)	Low (°C)		Rainfall (mm)	Snowfall ² (mm)	Total Precip.
01 (Mon)	197.5	43.4	26	8	Cloudy, P. Sunny	0.0	0.0	0.0
02 (Tue)	192.6	42.4	28	11	Sunny, P. Cloudy	0.0	0.0	0.0
03 (Wed)	203.9	44.9	22	12	Cloudy, Showers	0.0	0.0	0.0
04 (Thu)	202.6	44.6	18	11	P. Sunny	0.0	0.0	0.0
05 (Fri)	176.1	38.7	16	9	Cloudy, P. Sunny	0.2	0.0	0.2
06 (Sat)	184.6	40.6	14	7	Cloudy, P. Sunny, Showers	4.2	0.0	4.2
07 (Sun)	191.0	42.0	18	8	Cloudy, P. Sunny	0.0	0.0	0.0
08 (Mon)	164.8	36.2	13	10	P. Sunny, Showers	13.7	0.0	13.7
09 (Tue)	145.1	<=Min	15	9	P. Sunny, Showers	1.9	0.0	1.9
10 (Wed)	183.1	40.3	19	7	Cloudy, P. Sunny	0.0	0.0	0.0
11 (Thu)	189.1	41.6	21	7	P. Sunny	0.0	0.0	0.0
12 (Fri)	184.8	40.7	24	9	P. Sunny	0.0	0.0	0.0
13 (Sat)	211.3	46.5	28	11	Sunny, P. Cloudy	0.0	0.0	0.0
14 (Sun)	223.2	49.1	32	13	Cloudy, P. Sunny	0.0	0.0	0.0
15 (Mon)	202.3	44.5	31	16	Cloudy, P. Sunny	0.0	0.0	0.0
16 (Tue)	188.7	41.5	22	12	Sunny, P. Cloudy	0.0	0.0	0.0
17 (Wed)	221.3	48.7	22	10	Sunny, P. Cloudy	0.0	0.0	0.0
18 (Thu)	222.6	49.0	26	11	Sunny	0.0	0.0	0.0
19 (Fri)	198.5	43.7	28	12	Sunny	0.0	0.0	0.0
20 (Sat)	210.1	46.2	23	11	Sunny	0.0	0.0	0.0
21 (Sun)	224.3	49.3	27	11	Sunny	0.0	0.0	0.0
22 (Mon)	207.7	45.7	30	13	Sunny	0.0	0.0	0.0
23 (Tue)	204.8	45.1	32	14	Cloudy, P. Sunny	0.0	0.0	0.0
24 (Wed)	234.6	<=Max	30	14	Sunny, P. Cloudy	0.0	0.0	0.0
25 (Thu)	201.5	44.3	18	13	Cloudy, P. Sunny, Showers	1.2	0.0	1.2
26 (Fri)	168.5	37.1	16	11	Cloudy, P. Sunny, Showers	2.5	0.0	2.5
27 (Sat)	201.2	44.3	21	10	Sunny, P. Cloudy	0.0	0.0	0.0
28 (Sun)	207.1	45.6	20	10	Sunny, P. Cloudy	0.0	0.0	0.0
29 (Mon)	194.7	42.8	19	12	Cloudy, P. Sunny	0.0	0.0	0.0
30 (Tue)	184.2	40.5	20	12	Cloudy, P. Sunny	0.0	0.0	0.0
TOTAL	5921.8 ML	1302.73 MIG				23.7	0	23.7
MAX	234.6	51.61	32	16		13.7	0	13.7
AVG	197.4	43.42	22.5	10.8		0.8	0	0.8
MIN	145.1	31.92	13	7		0.0	0	0.0

1. ML = Million Litres

2. 10% of snow depth applied to rainfall figures for snow to water equivalent.

Average Rainfall for June (1914-2025)	21.9 mm
Actual Rainfall: June	23.7 mm
% of Average	108%
Average Rainfall (1914-2025): Sept 01 - Jul 05	1,586.1 mm
Actual Rainfall (2025/26): Sept 01 - Jul 05	1,640.1 mm
% of Average	103%

Number days with precip. 0.2 or more
6

Water spilled at Sooke Reservoir to date (since Sept. 1) =

4.26 Billion Imperial Gallons

19.40 Billion Litres

Daily Consumptions: - July 2026

Date	Total Consumption		Air Temperature @ Japan Gulch		Weather Conditions	Precipitation @ Sooke Res.: 12:00am to 12:00am		
	(ML) ¹	(MIG) ²	High (°C)	Low (°C)		Rainfall (mm)	Snowfall ² (mm)	Total Precip.
01 (Wed)	214.9 <=Max	47.3	20	12	Cloudy, P. Sunny	0.0	0.0	0.0
02 (Thu)	190.2	41.8	16	12	Cloudy, Showers	5.2	0.0	5.2
03 (Fri)	165.2 <=Min	36.3	20	12	Cloudy, P. Sunny	0.0	0.0	0.0
04 (Sat)	194.5	42.8	20	11	Sunny	0.0	0.0	0.0
05 (Sun)	209.2	46.0	24	10	Sunny, P. Cloudy	0.0	0.0	0.0
06 (Mon)								
07 (Tue)								
08 (Wed)								
09 (Thu)								
10 (Fri)								
11 (Sat)								
12 (Sun)								
13 (Mon)								
14 (Tue)								
15 (Wed)								
16 (Thu)								
17 (Fri)								
18 (Sat)								
19 (Sun)								
20 (Mon)								
21 (Tue)								
22 (Wed)								
23 (Thu)								
24 (Fri)								
25 (Sat)								
26 (Sun)								
27 (Mon)								
28 (Tue)								
29 (Wed)								
30 (Thu)								
31 (Fri)								
TOTAL	974.0 ML	214.3 MIG				5.2	0	5.2
MAX	214.9	47.29	24	12		5.2	0	5.2
AVG	194.8	42.86	20.0	11.1		1.0	0	1.0
MIN	165.2	36.34	16	10		0.0	0	0.0

1. ML = Million Litres

2. 10% of snow depth applied to rainfall figures for snow to water equivalent.

Average Rainfall for July (1914-2025)	21.9 mm
Actual Rainfall: July	5.2 mm
% of Average	24%
Average Rainfall (1914-2025): Sept 01 - Jul 05	1,586.1 mm
Actual Rainfall (2025/26): Sept 01 - Jul 05	1,640.1 mm
% of Average	103%

Number days with precip. 0.2 or more
1


Water spilled at Sooke Reservoir to date (since Sept. 1) =

4.26 Billion Imperial Gallons

19.40 Billion Litres


SOOKE LAKE RESERVOIR STORAGE SUMMARY

2025 / 2026

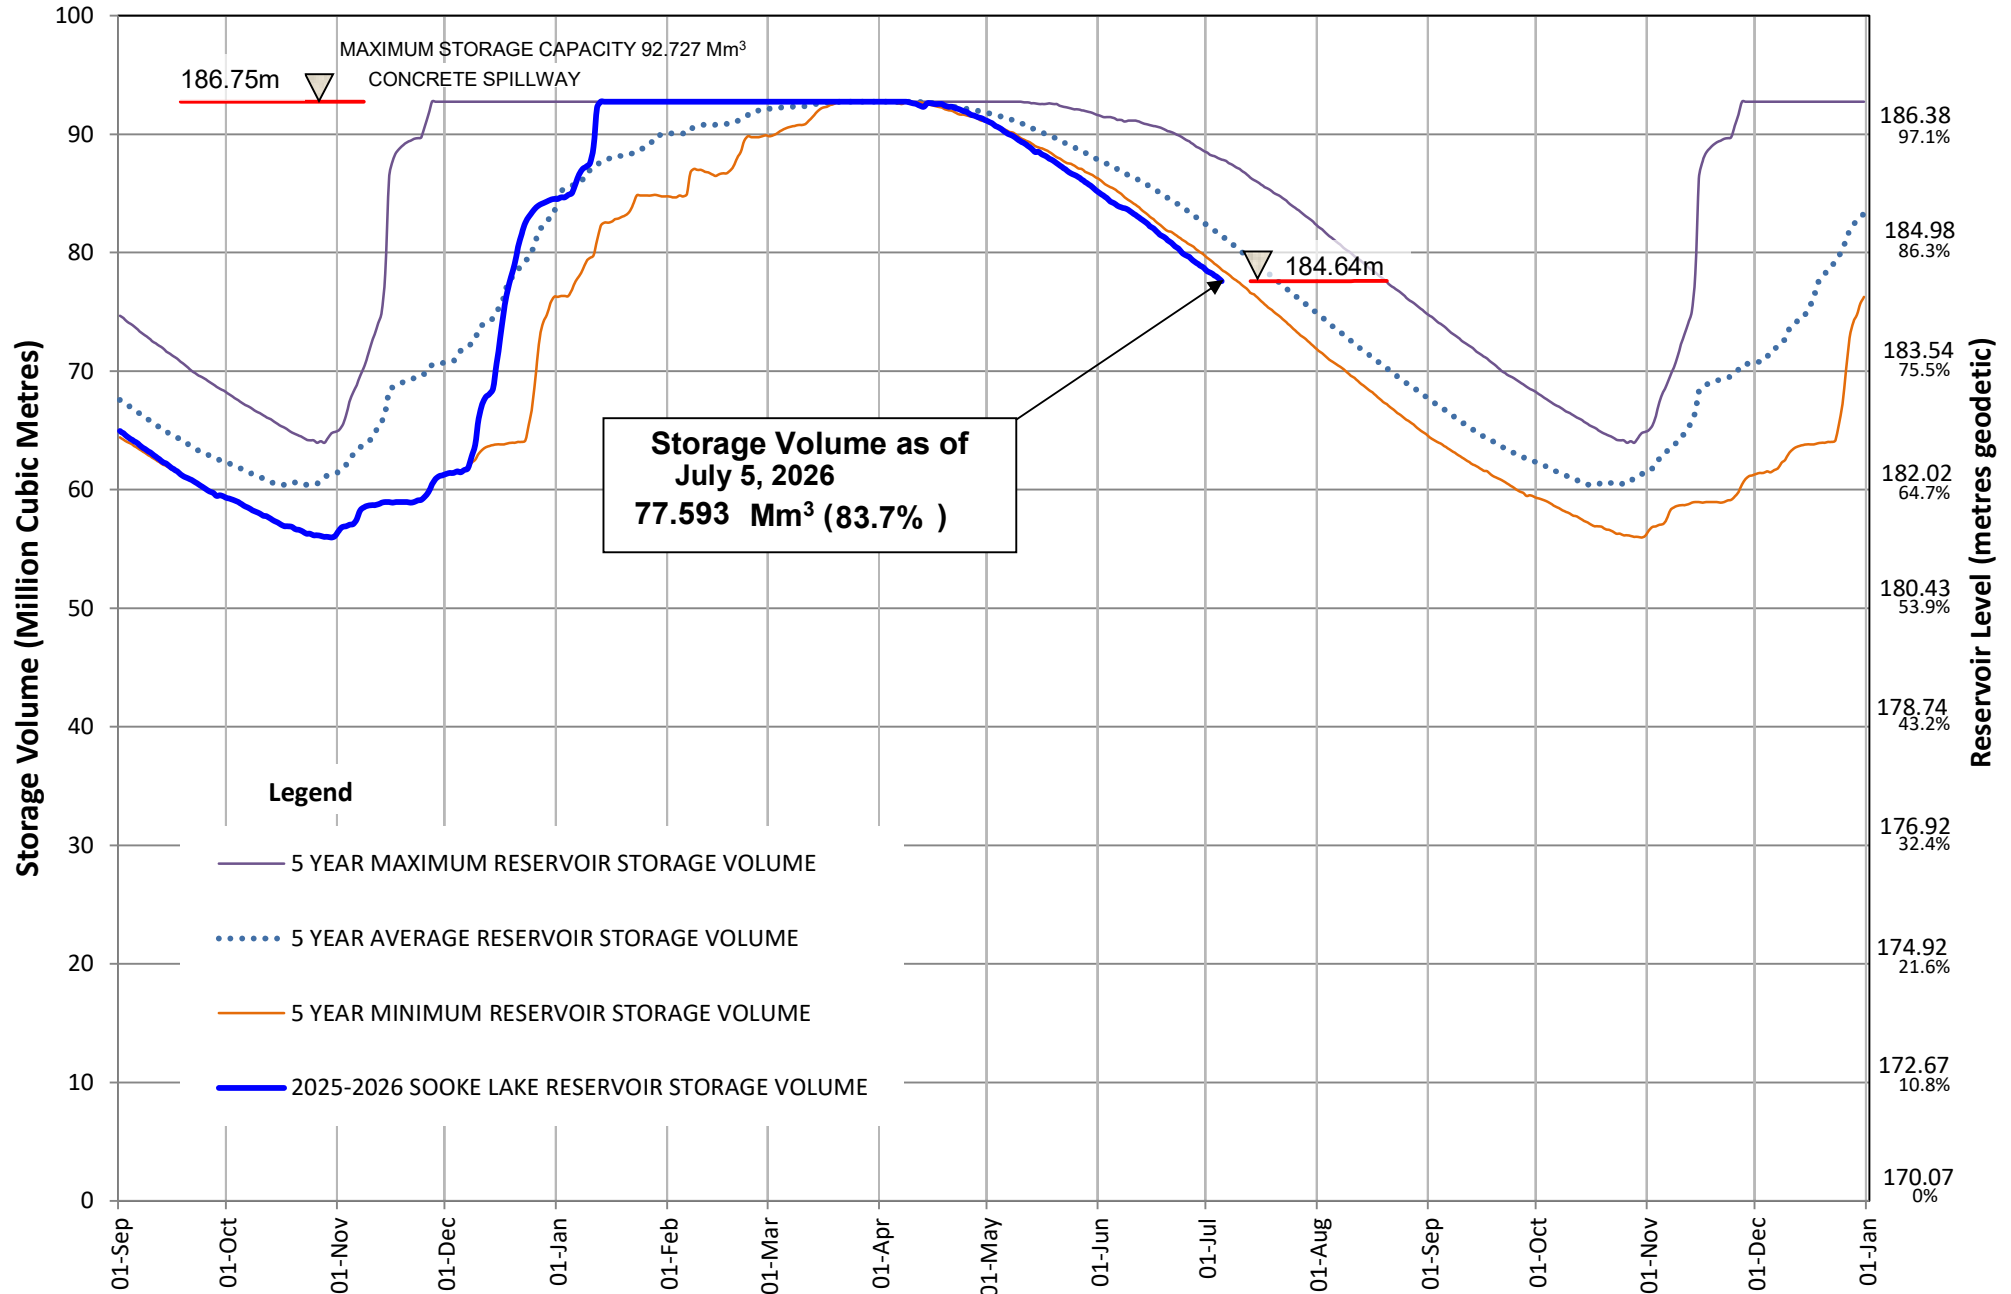

Sooke Lake Reservoir Storage Level

Water Supply Management Plan

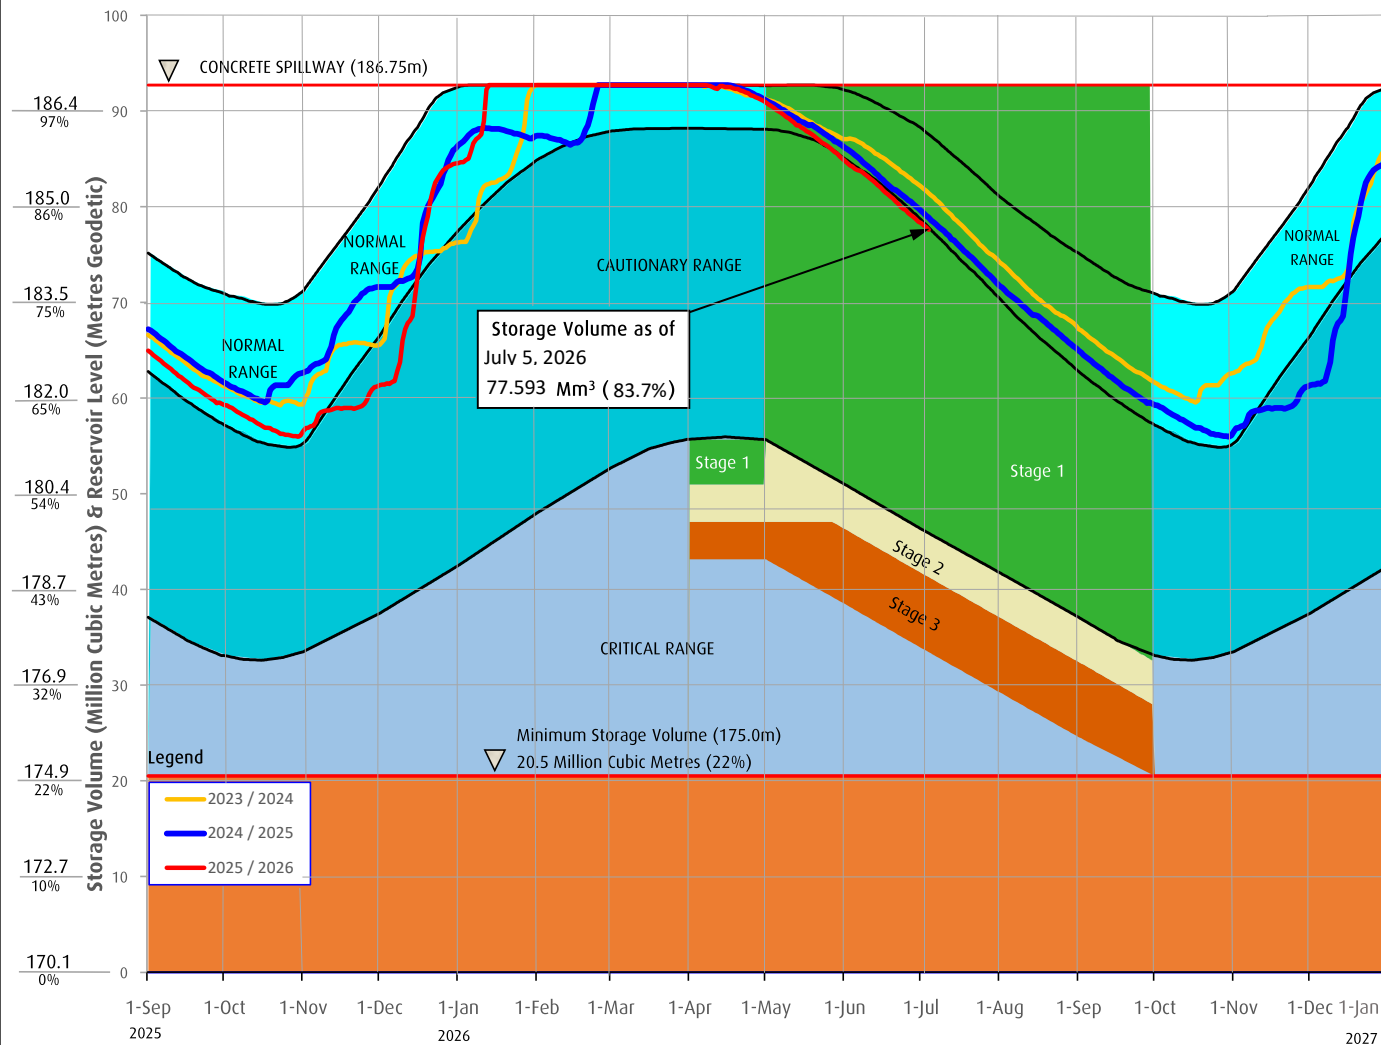

FAQs

How are water restriction stages determined?

Several factors are considered when determining water use restriction stages, including,

1. Time of year and typical seasonal water demand trends;
2. Precipitation and temperature conditions and forecasts;
3. Storage levels and storage volumes of water reservoirs (Sooke Lake Reservoir and the Goldstream Reservoirs) and draw down rates;
4. Stream flows and inflows into Sooke Lake Reservoir;
5. Water usage, recent consumption and trends; and customer compliance with restriction;
6. Water supply system performance.

The Regional Water Supply Commission will consider the above factors in making a determination to implement stage 2 or 3 restrictions, under the Water Conservation Bylaw.

At any time of the year and regardless of the water use restriction storage, customers are encouraged to limit discretionary water use in order to maximize the amount of water in the Regional Water Supply System Reservoirs available for nondiscretionary potable water use.

Stage 1 is normally initiated every year from May 1 to September 30 to manage outdoor use during the summer months. During this time, lawn watering is permitted twice a week at different times for even and odd numbered addresses.

Stage 2 Is initiated when it is determined that there is an acute water supply shortage. During this time, lawn water is permitted once a week at different times for even and odd numbered addresses.

Stage 3 Is initiated when it is determined that there is a severe water supply shortage. During this time, lawn watering is not permitted. Other outdoor water use activities are restricted as well.

For more information, visit www.crd.bc.ca/drinkingwater

CRD
Making a difference...together

Useable Reservoir Volumes in Storage for July 05, 2026

