

CAPITAL REGIONAL DISTRICT - INFRASTRUCTURE & WATER SERVICES**Water Watch**

Issued March 09, 2026

Water Supply System Summary:**1. Useable Volume in Storage:**

Reservoir	March 31 5 Year Ave		March 31/25		March 8/26		% Existing Full Storage
	ML	MIG	ML	MIG	ML	MIG	
Sooke	92,727	20,400	92,727	20,400	92,727	20,400	100.0%
Goldstream	9,675	2,129	9,825	2,161	9,906	2,179	99.9%
Total	102,402	22,529	102,552	22,561	102,633	22,579	100.0%

2. Average Daily Demand:

For the month of March	105.9 MLD	23.3 MIGD
For week ending March 08, 2026	105.4 MLD	23.2 MIGD
Max. day March 2026, to date:	109.4 MLD	24.1 MIGD

3. Average 5 Year Daily Demand for March

Average (2021 - 2025)	105.4 MLD ¹	23.2 MIGD ²
-----------------------	------------------------	------------------------

¹MLD = Million Litres Per Day ²MIGD = Million Imperial Gallons Per Day

4. Rainfall March:

Average (1914 - 2025):	158.6 mm
Actual Rainfall to Date	36.2 mm (23% of monthly average)

5. Rainfall: Sep 1- Mar 8

Average (1914 - 2025):	1,295.3 mm
2025/2026	1,347.7 mm (104% of average)

6. Water Conservation Required Action:

To avoid possible leaks this spring, now is the time to winterize your sprinkler system.
Visit our website at www.crd.bc.ca/water for more information.

If you require further information, please contact:

Alicia Fraser, P. Eng.
General Manager, CRD - Infrastructure and Water Services
or
Glenn Harris, Ph D., RPBio
Senior Manager - Environmental Protection

CRD Infrastructure & Water Services
479 Island Highway
Victoria, BC V9B 1H7
(250) 474-9600

Daily Consumption

March 2026


Average Daily Consumption = 105.9 M.L.

- 2026 Actual Daily Consumption
- 5 Year Average Daily Consumption for the Month
- 2025 Average Daily Consumption for the Month

Consumption (Million Litres)

Day

01 (Sun) 02 (Mon) 03 (Tue) 04 (Wed) 05 (Thu) 06 (Fri) 07 (Sat) 08 (Sun) 09 (Mon) 10 (Tue) 11 (Wed) 12 (Thu) 13 (Fri) 14 (Sat) 15 (Sun) 16 (Mon) 17 (Tue) 18 (Wed) 19 (Thu) 20 (Fri) 21 (Sat) 22 (Sun) 23 (Mon) 24 (Tue) 25 (Wed) 26 (Thu) 27 (Fri) 28 (Sat) 29 (Sun) 30 (Mon) 31 (Tue)

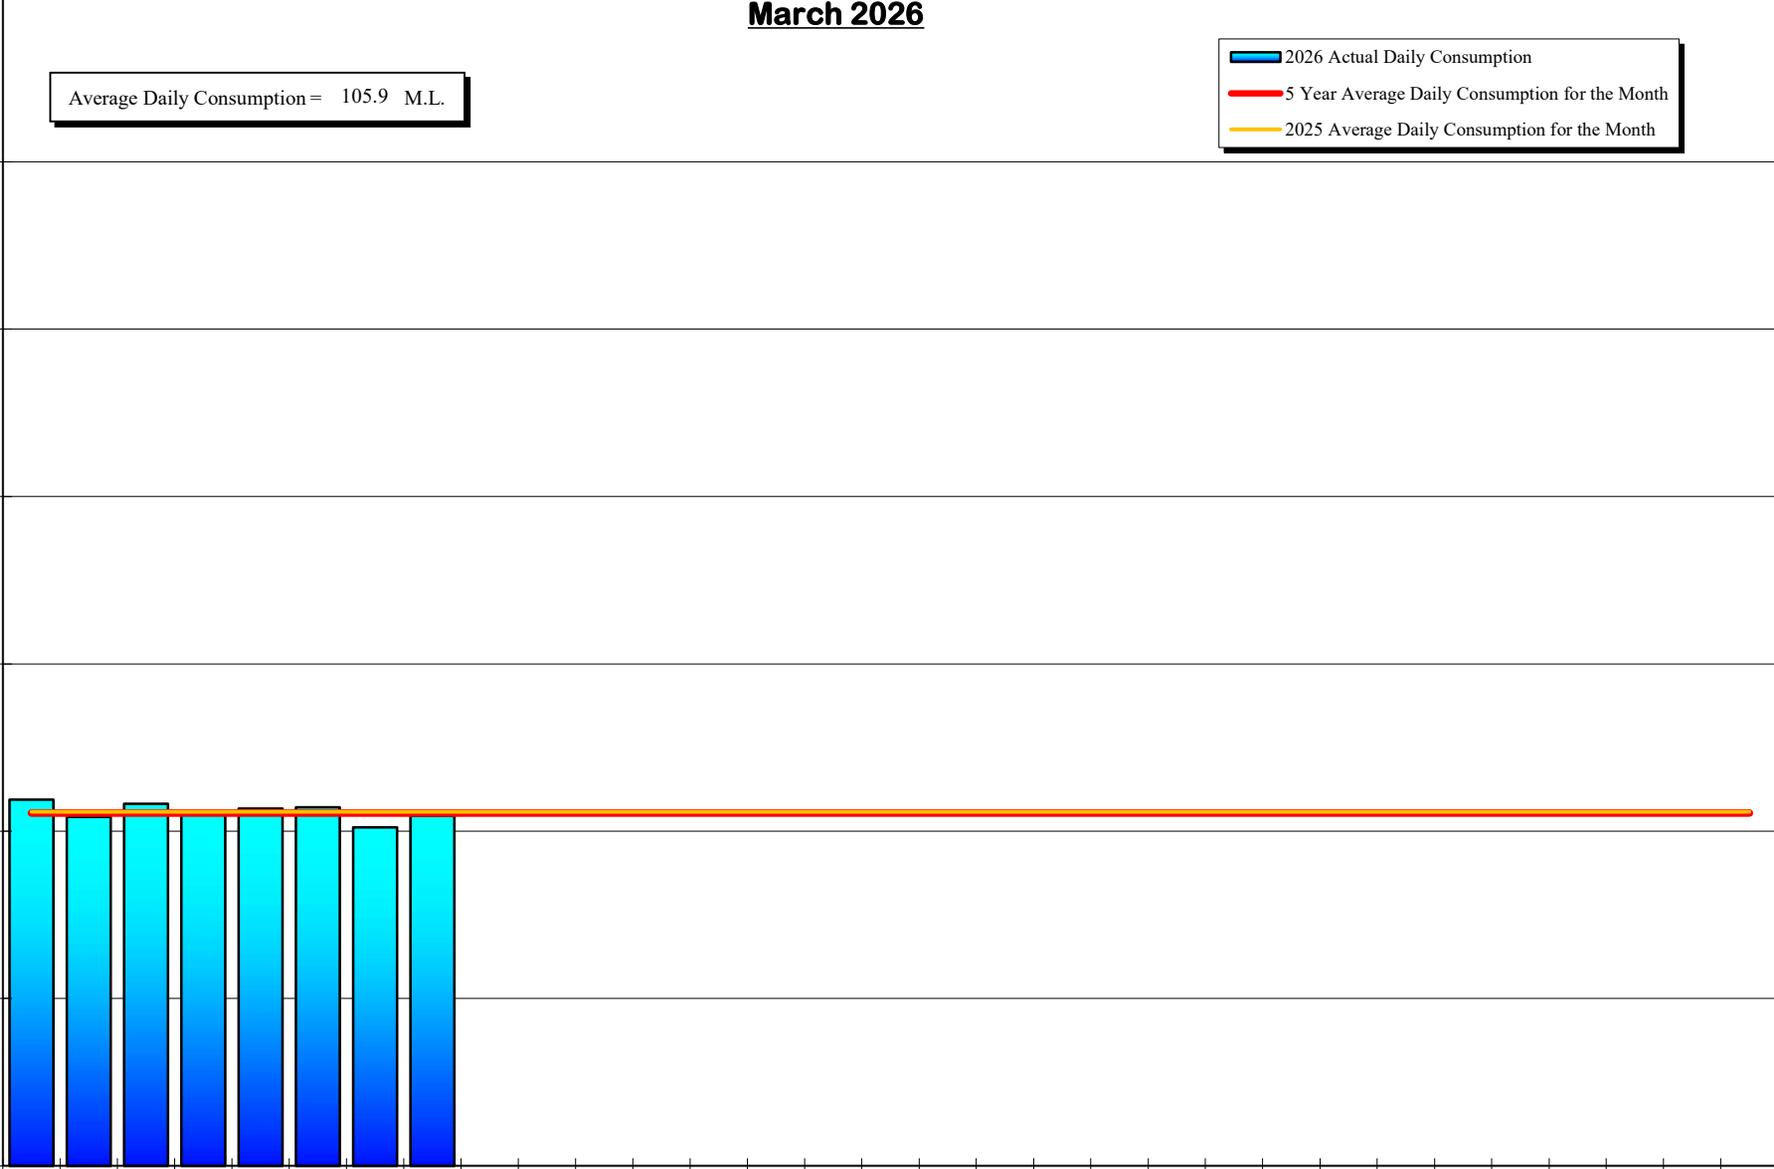

Daily Consumptions: - March 2026

Date	Total Consumption		Air Temperature @ Japan Gulch		Weather Conditions	Precipitation @ Sooke Res.: 12:00am to 12:00am			
	(ML) ¹	(MIG) ²	High (°C)	Low (°C)		Rainfall (mm)	Snowfall ⁷ (mm)	Total Precip.	
01 (Sun)	109.4	<=Max	24.1	11	0	Cloudy / P. Sunny / Showers	0.2	0.0	0.2
02 (Mon)	104.3		23.0	11	1	Sunny	0.0	0.0	0.0
03 (Tue)	108.2		23.8	11	5	Cloudy / Showers	7.0	0.0	7.0
04 (Wed)	106.1		23.3	11	6	Cloudy / P. Sunny / Showers	11.5	0.0	11.5
05 (Thu)	106.7		23.5	11	5	Cloudy / P. Sunny / Showers	2.4	0.0	2.4
06 (Fri)	107.1		23.6	8	6	Cloudy / Showers	8.4	0.0	8.4
07 (Sat)	101.1	<=Min	22.2	13	7	Cloudy / Showers	5.0	0.0	5.0
08 (Sun)	104.6		23.0	10	1	Cloudy / P. Sunny / Showers	1.7	0.0	1.7
09 (Mon)									
10 (Tue)									
11 (Wed)									
12 (Thu)									
13 (Fri)									
14 (Sat)									
15 (Sun)									
16 (Mon)									
17 (Tue)									
18 (Wed)									
19 (Thu)									
20 (Fri)									
21 (Sat)									
22 (Sun)									
23 (Mon)									
24 (Tue)									
25 (Wed)									
26 (Thu)									
27 (Fri)									
28 (Sat)									
29 (Sun)									
30 (Mon)									
31 (Tue)									
TOTAL	847.5 ML		186.45 MIG				36.2	0	36.2
MAX	109.4		24.06	13	7		11.5	0	11.5
AVG	105.9		23.31	10.8	3.7		4.5	0	4.5
MIN	101.1		22.25	8	0		0.0	0	0.0

1. ML = Million Litres

2. 10% of snow depth applied to rainfall figures for snow to water equivalent.

Average Rainfall for March (1914-2025)	158.6 mm
Actual Rainfall: March	36.2 mm
% of Average	23%
Average Rainfall (1914-2025): Sept 01 - Mar 08	1,295.3 mm
Actual Rainfall (2025/26): Sept 01 - Mar 08	1,347.7 mm
% of Average	104%


Number days with precip. 0.2 or more
7

Water spilled at Sooke Reservoir to date (since Sept. 1) =

2.70 Billion Imperial Gallons
12.30 Billion Litres


SOOKE LAKE RESERVOIR STORAGE SUMMARY

2025 / 2026

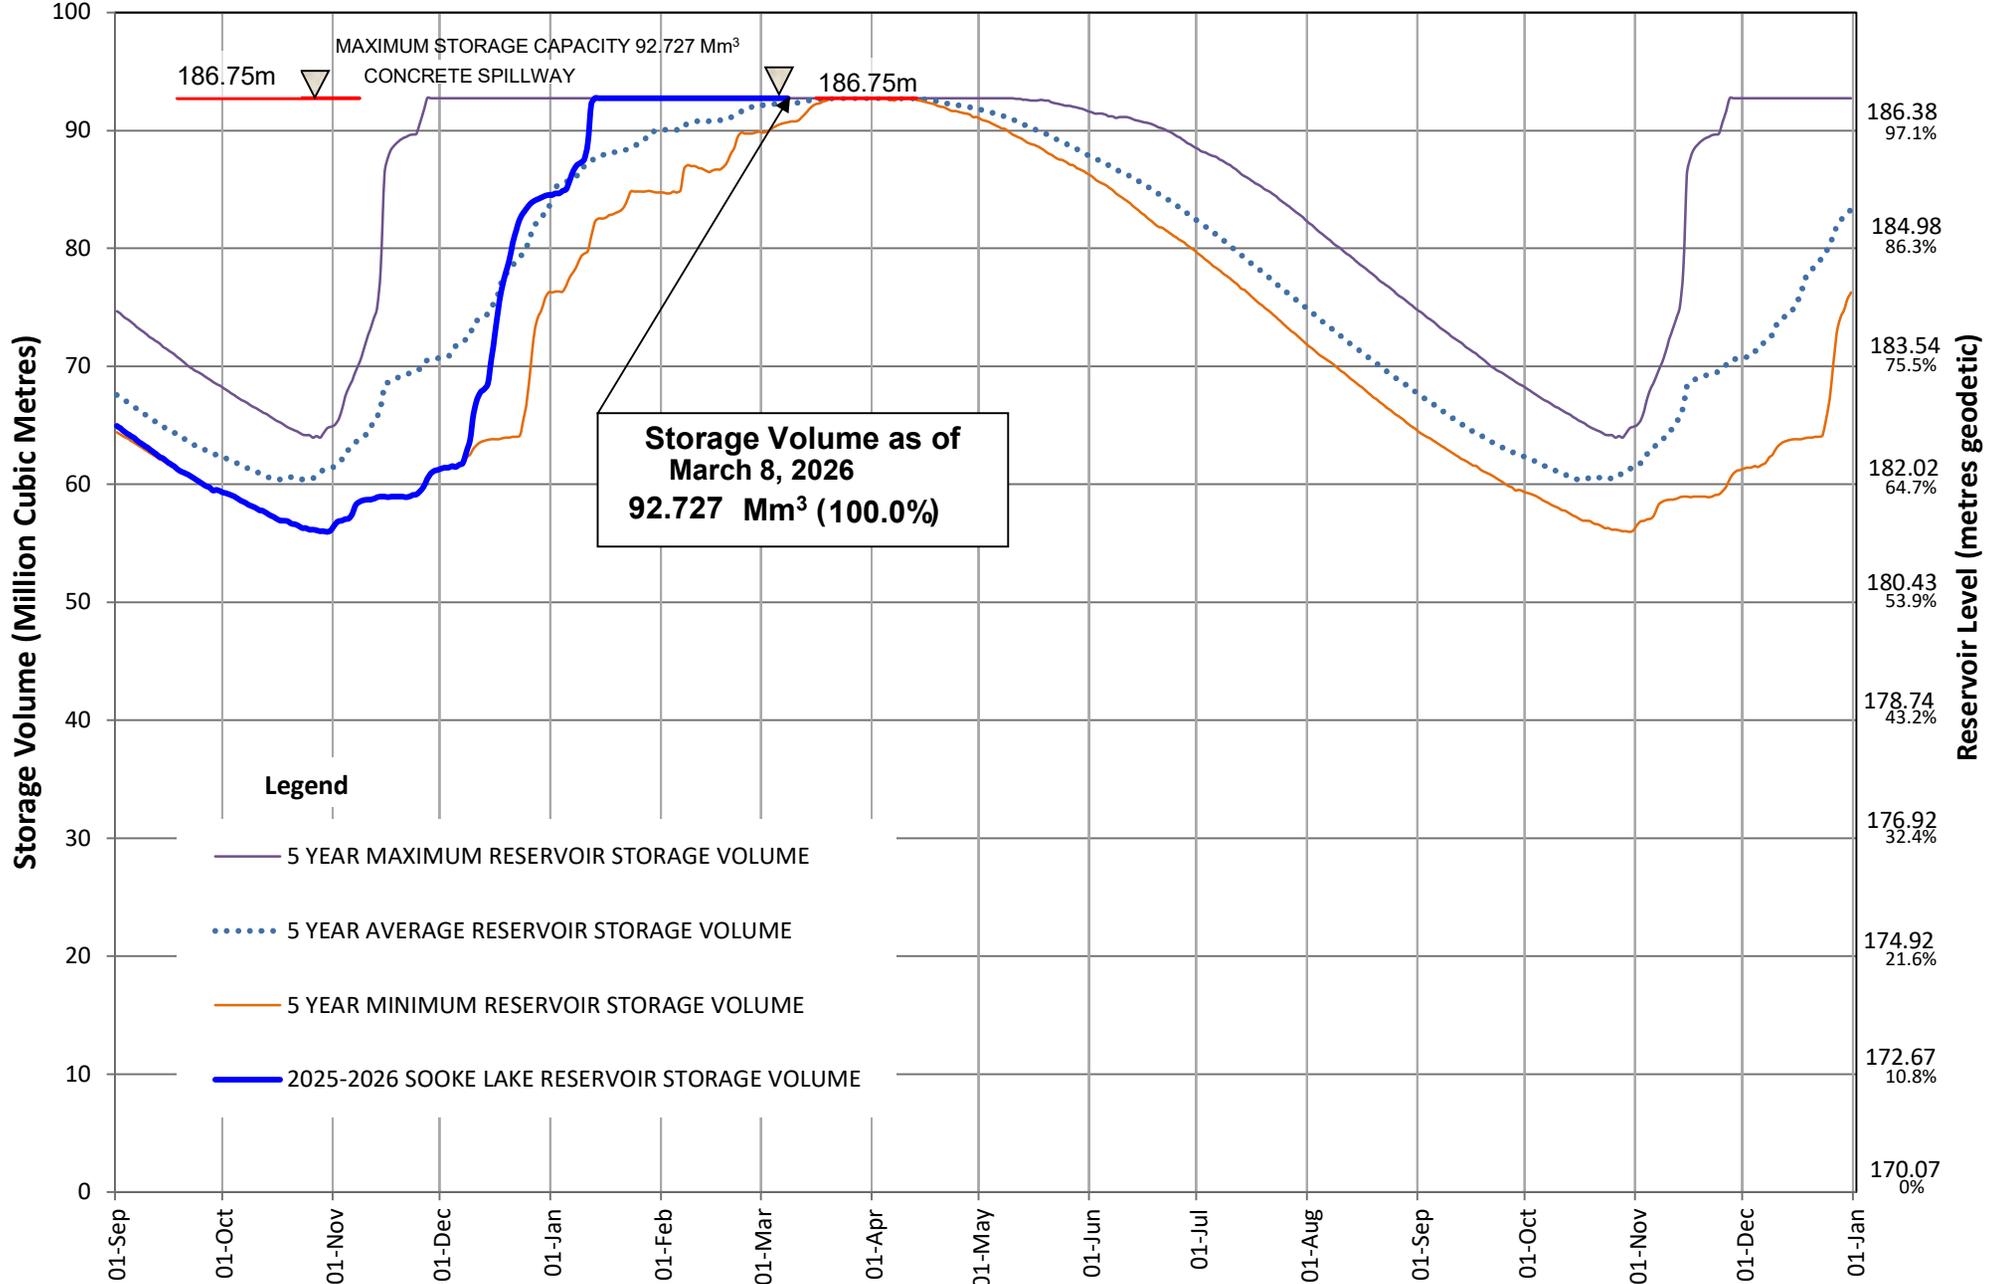

Sooke Lake Reservoir Storage Level

Water Supply Management Plan

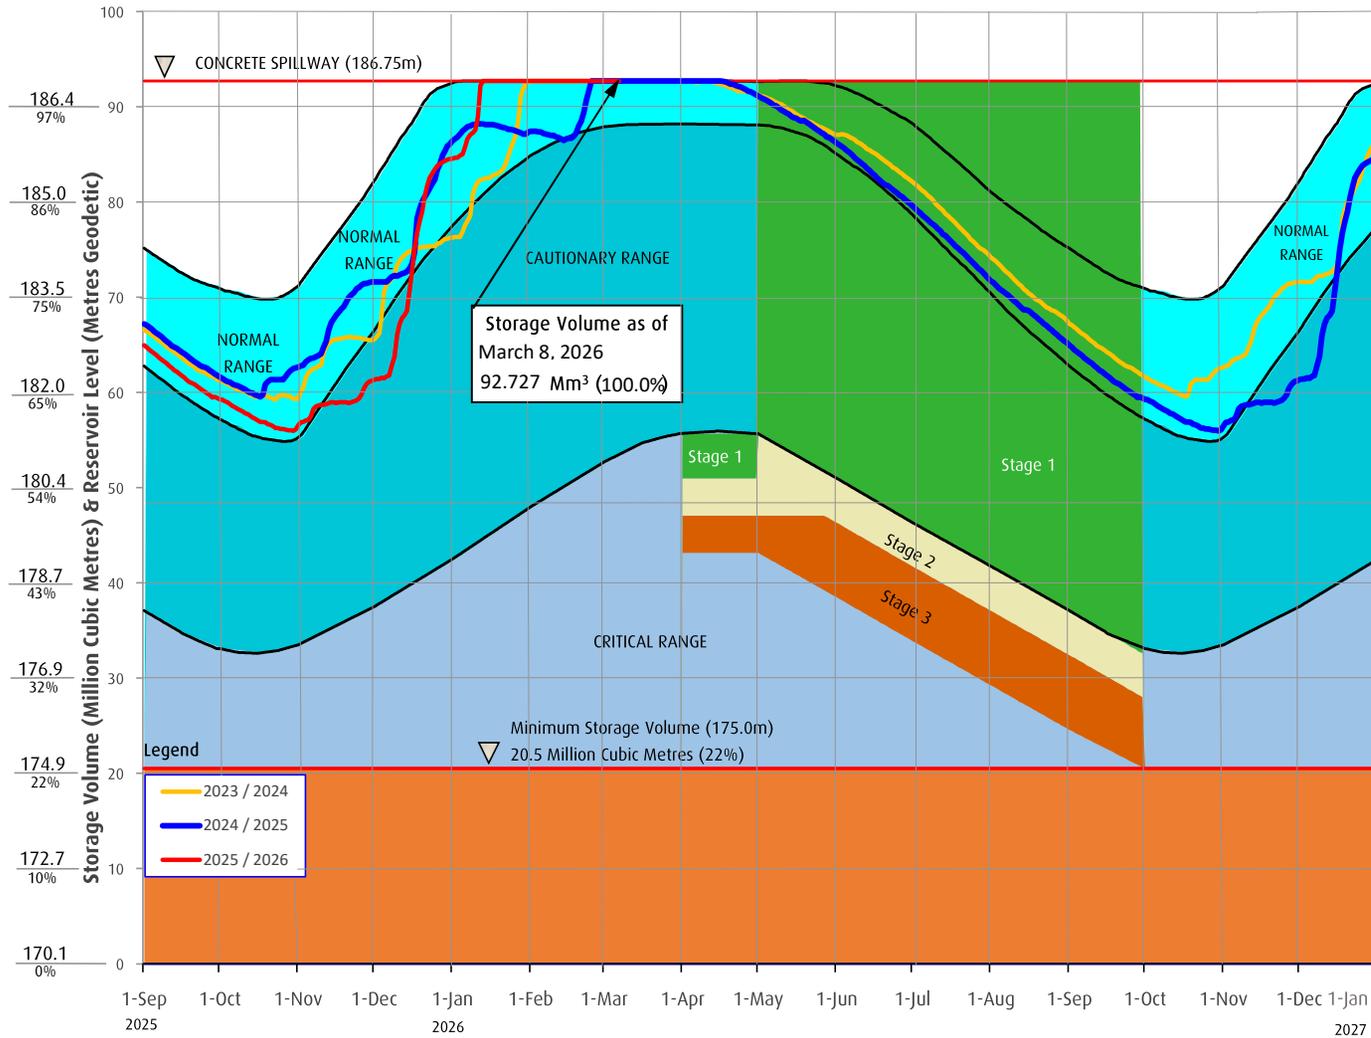

FAQs

How are water restriction stages determined?

Several factors are considered when determining water use restriction stages, including,

1. Time of year and typical seasonal water demand trends;
2. Precipitation and temperature conditions and forecasts;
3. Storage levels and storage volumes of water reservoirs (Sooke Lake Reservoir and the Goldstream Reservoirs) and draw down rates;
4. Stream flows and inflows into Sooke Lake Reservoir;
5. Water usage, recent consumption and trends; and customer compliance with restriction;
6. Water supply system performance.

The Regional Water Supply Commission will consider the above factors in making a determination to implement stage 2 or 3 restrictions, under the Water Conservation Bylaw.

At any time of the year and regardless of the water use restriction storage, customers are encouraged to limit discretionary water use in order to maximize the amount of water in the Regional Water Supply System Reservoirs available for nondiscretionary potable water use.

Stage 1 is normally initiated every year from May 1 to September 30 to manage outdoor use during the summer months. During this time, lawn watering is permitted twice a week at different times for even and odd numbered addresses.

Stage 2 is initiated when it is determined that there is an acute water supply shortage. During this time, lawn water is permitted once a week at different times for even and odd numbered addresses.

Stage 3 is initiated when it is determined that there is a severe water supply shortage. During this time, lawn watering is not permitted. Other outdoor water use activities are restricted as well.

For more information, visit www.crd.bc.ca/drinkingwater



Useable Reservoir Volumes in Storage for March 08, 2026

