

CAPITAL REGIONAL DISTRICT - INTEGRATED WATER SERVICES

Water Watch

Issued January 26, 2026

Water Supply System Summary:

1. Useable Volume in Storage:

Reservoir	January 31 5 Year Ave		January 31/25		January 25/26		% Existing Full Storage
	ML	MIG	ML	MIG	ML	MIG	
Sooke	90,043	19,809	87,340	19,215	92,727	20,400	100.0%
Goldstream	9,652	2,123	9,824	2,161	9,905	2,179	99.9%
Total	99,695	21,933	97,164	21,376	102,632	22,579	100.0%

2. Average Daily Demand:

For the month of January	105.8 MLD	23.3 MIGD
For week ending January 25, 2026	106.4 MLD	23.4 MIGD
Max. day January 2026, to date:	111.1 MLD	24.4 MIGD

3. Average 5 Year Daily Demand for January

Average (2021 - 2025)	104.7 MLD ¹	23.0 MIGD ²
-----------------------	------------------------	------------------------

¹MLD = Million Litres Per Day

²MIGD = Million Imperial Gallons Per Day

4. Rainfall January:

Average (1914 - 2025):	268.7 mm
Actual Rainfall to Date	209.5 mm (78% of monthly average)

5. Rainfall: Sep 1- Jan 25

Average (1914 - 2025):	1,015.8 mm
2025/2026	1,090.1 mm (107% of average)

6. Water Conservation Required Action:

To avoid possible leaks this spring, now is the time to winterize your sprinkler system.
Visit our website at www.crd.bc.ca/water for more information.

If you require further information, please contact:

Alicia Fraser, P. Eng.
General Manager, CRD - Integrated Water Services
or
Glenn Harris, Ph D., RPBio
Senior Manager - Environmental Protection

Capital Regional District Integrated Water Services
479 Island Highway
Victoria, BC V9B 1H7
(250) 474-9600

Daily Consumption

January 2026


Average Daily Consumption = 105.8 M.L.

2026 Actual Daily Consumption
5 Year Average Daily Consumption for the Month
2025 Average Daily Consumption for the Month

Consumption (Million Litres)

Day

01 (Thu) 02 (Fri) 03 (Sat) 04 (Sun) 05 (Mon) 06 (Tue) 07 (Wed) 08 (Thu) 09 (Fri) 10 (Sat) 11 (Sun) 12 (Mon) 13 (Tue) 14 (Wed) 15 (Thu) 16 (Fri) 17 (Sat) 18 (Sun) 19 (Mon) 20 (Tue) 21 (Wed) 22 (Thu) 23 (Fri) 24 (Sat) 25 (Sun) 26 (Mon) 27 (Tue) 28 (Wed) 29 (Thu) 30 (Fri) 31 (Sat)

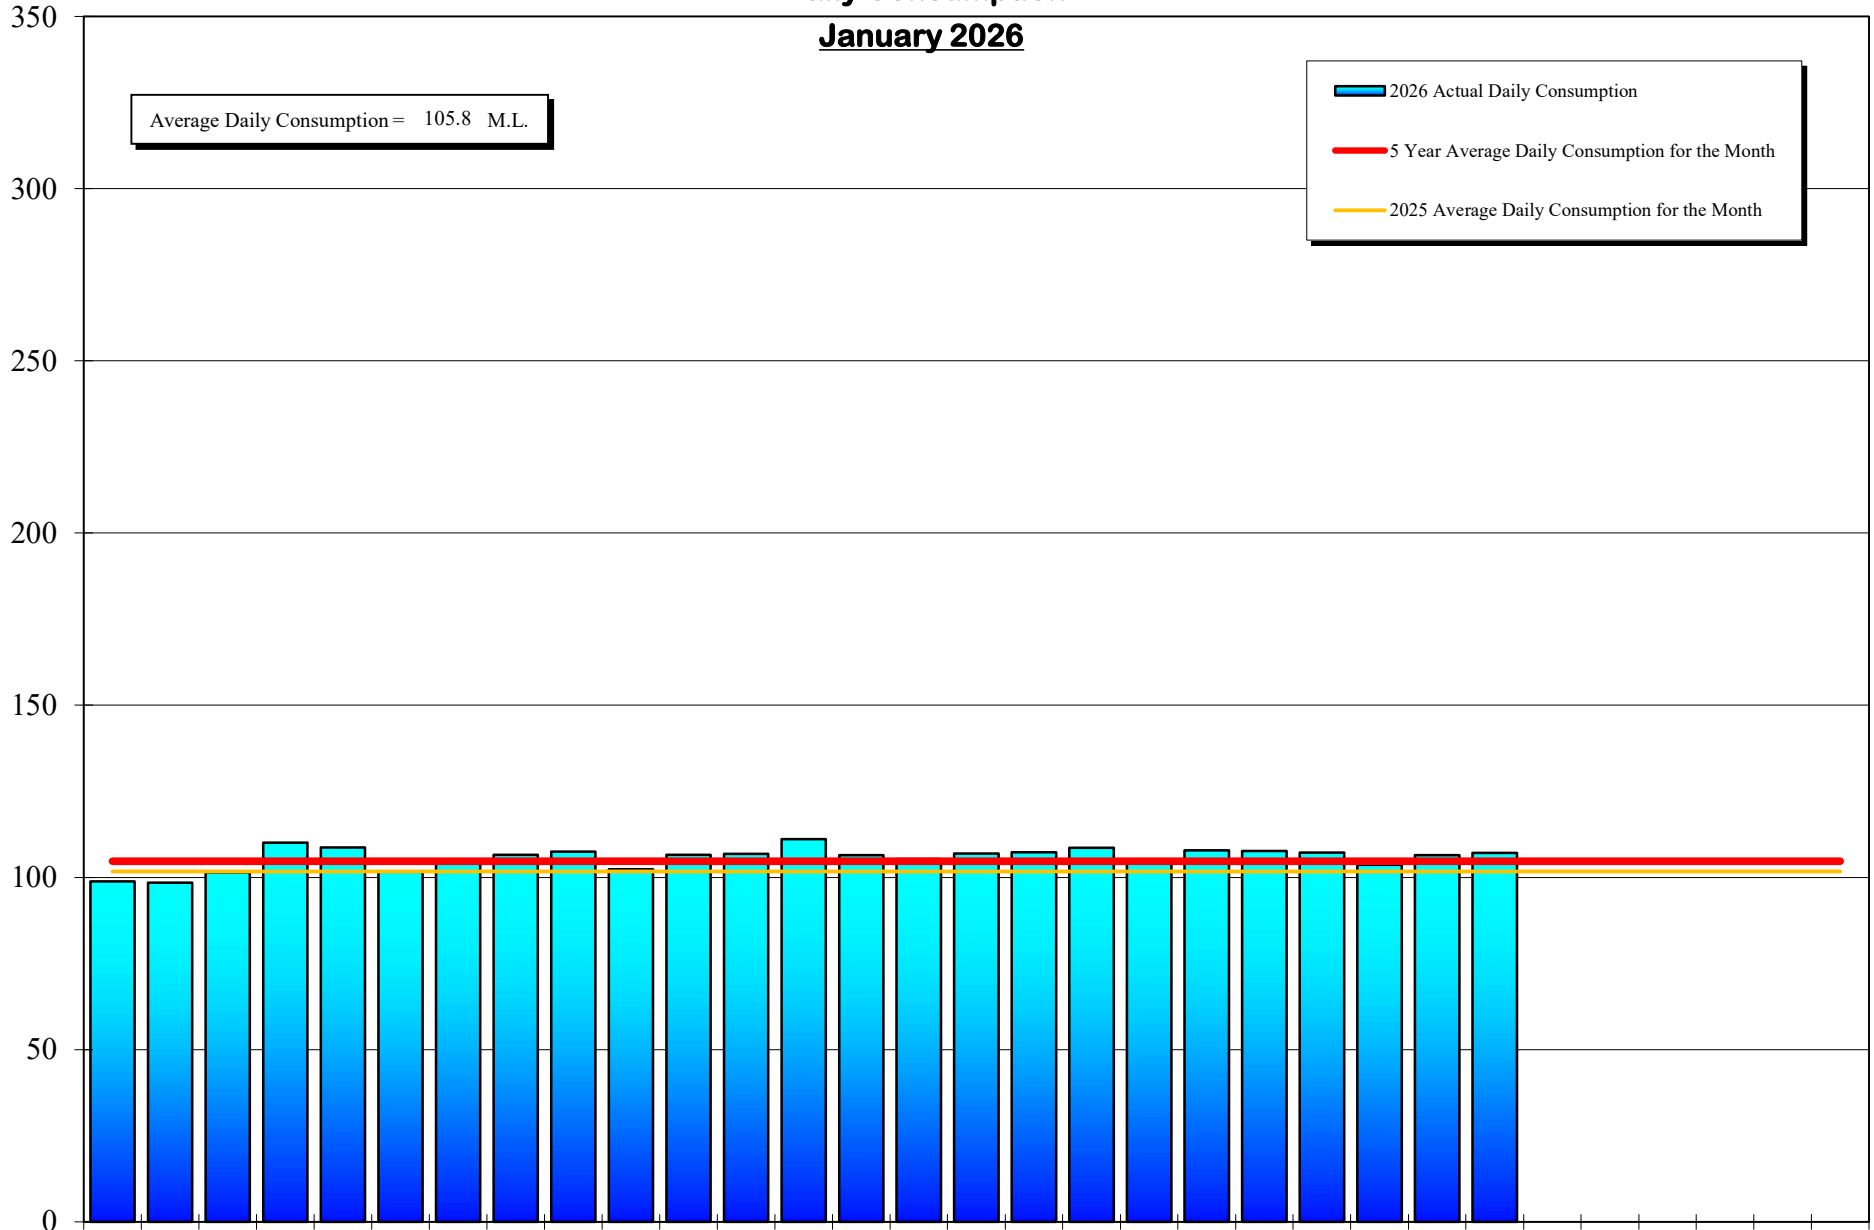

Daily Consumptions: - January 2026

Date	Total Consumption		Air Temperature @ Japan Gulch		Weather Conditions	Precipitation @ Sooke Res.: 12:00am to 12:00am		
	(ML) ^{1.}	(MIG) ^{2.}	High (°C)	Low (°C)		Rainfall (mm)	Snowfall ^{2.} (mm)	Total Precip.
01 (Thu)	98.8	21.7	5	0	Cloudy / Fog	0.0	0.0	0.0
02 (Fri)	98.5 <=Min	21.7	6	3	Cloudy / Fog / Showers	2.0	0.0	2.0
03 (Sat)	101.4	22.3	8	5	Cloudy / Fog / Showers	12.3	0.0	12.3
04 (Sun)	110.1	24.2	7	4	Cloudy / Showers	5.9	0.0	5.9
05 (Mon)	108.7	23.9	5	1	Cloudy / P. Sunny / Showers	1.8	0.0	1.8
06 (Tue)	101.6	22.3	6	1	Cloudy / P. Sunny / Rain	43.5	0.0	43.5
07 (Wed)	105.2	23.1	3	1	Cloudy / Rain	19.2	2.0	19.4
08 (Thu)	106.5	23.4	5	1	Cloudy / P. Sunny / Showers	0.9	0.0	0.9
09 (Fri)	107.5	23.7	7	4	Cloudy / Showers	1.0	0.0	1.0
10 (Sat)	102.4	22.5	7	4	Cloudy / Fog / Showers	13.0	0.0	13.0
11 (Sun)	106.5	23.4	8	6	Cloudy / Fog / Rain	52.0	0.0	52.0
12 (Mon)	106.8	23.5	11	7	Cloudy / Fog / Rain	55.4	0.0	55.4
13 (Tue)	111.1 <=Max	24.4	11	9	Cloudy / Fog / Showers	1.0	0.0	1.0
14 (Wed)	106.4	23.4	10	7	Cloudy / Fog / Showers	0.7	0.0	0.7
15 (Thu)	105.3	23.2	8	3	Cloudy / P. Sunny	0.0	0.0	0.0
16 (Fri)	106.9	23.5	6	2	Sunny	0.0	0.0	0.0
17 (Sat)	107.3	23.6	5	2	P. Sunny / Showers	0.2	0.0	0.2
18 (Sun)	108.6	23.9	6	2	Sunny	0.0	0.0	0.0
19 (Mon)	105.0	23.1	5	1	P. Sunny / Showers	0.2	0.0	0.2
20 (Tue)	107.8	23.7	6	0	Cloudy / P. Sunny	0.0	0.0	0.0
21 (Wed)	107.7	23.7	4	0	P. Sunny / Showers	0.2	0.0	0.2
22 (Thu)	107.2	23.6	5	0	Cloudy / Fog / P. Sunny	0.0	0.0	0.0
23 (Fri)	103.7	22.8	4	-1	Cloudy / P. Sunny	0.0	0.0	0.0
24 (Sat)	106.4	23.4	1	-2	Cloudy / P. Sunny	0.0	0.0	0.0
25 (Sun)	107.1	23.6	3	-3	Cloudy / Fog / P. Sunny	0.0	0.0	0.0
26 (Mon)								
27 (Tue)								
28 (Wed)								
29 (Thu)								
30 (Fri)								
31 (Sat)								
TOTAL	2644.5 ML	581.74 MIG				209.3	2	209.5
MAX	111.1	24.43	11	9		55.4	2	55.4
AVG	105.8	23.27	6.1	2.2		8.4	0	8.4
MIN	98.5	21.67	1	-3		0.0	0	0.0

1. ML = Million Litres

2. 10% of snow depth applied to rainfall figures for snow to water equivalent.

Average Rainfall for January (1914-2025)	268.7 mm
Actual Rainfall: January	209.5 mm
% of Average	78%
Average Rainfall (1914-2025): Sept 01 - Jan 25	1,015.8 mm
Actual Rainfall (2025/26): Sept 01 - Jan 25	1,090.1 mm
% of Average	107%

Number days with precip. 0.2 or more
16


Water spilled at Sooke Reservoir to date (since Sept. 1) =

0.50 Billion Imperial Gallons

2.30 Billion Litres


SOOKE LAKE RESERVOIR STORAGE SUMMARY

2025 / 2026

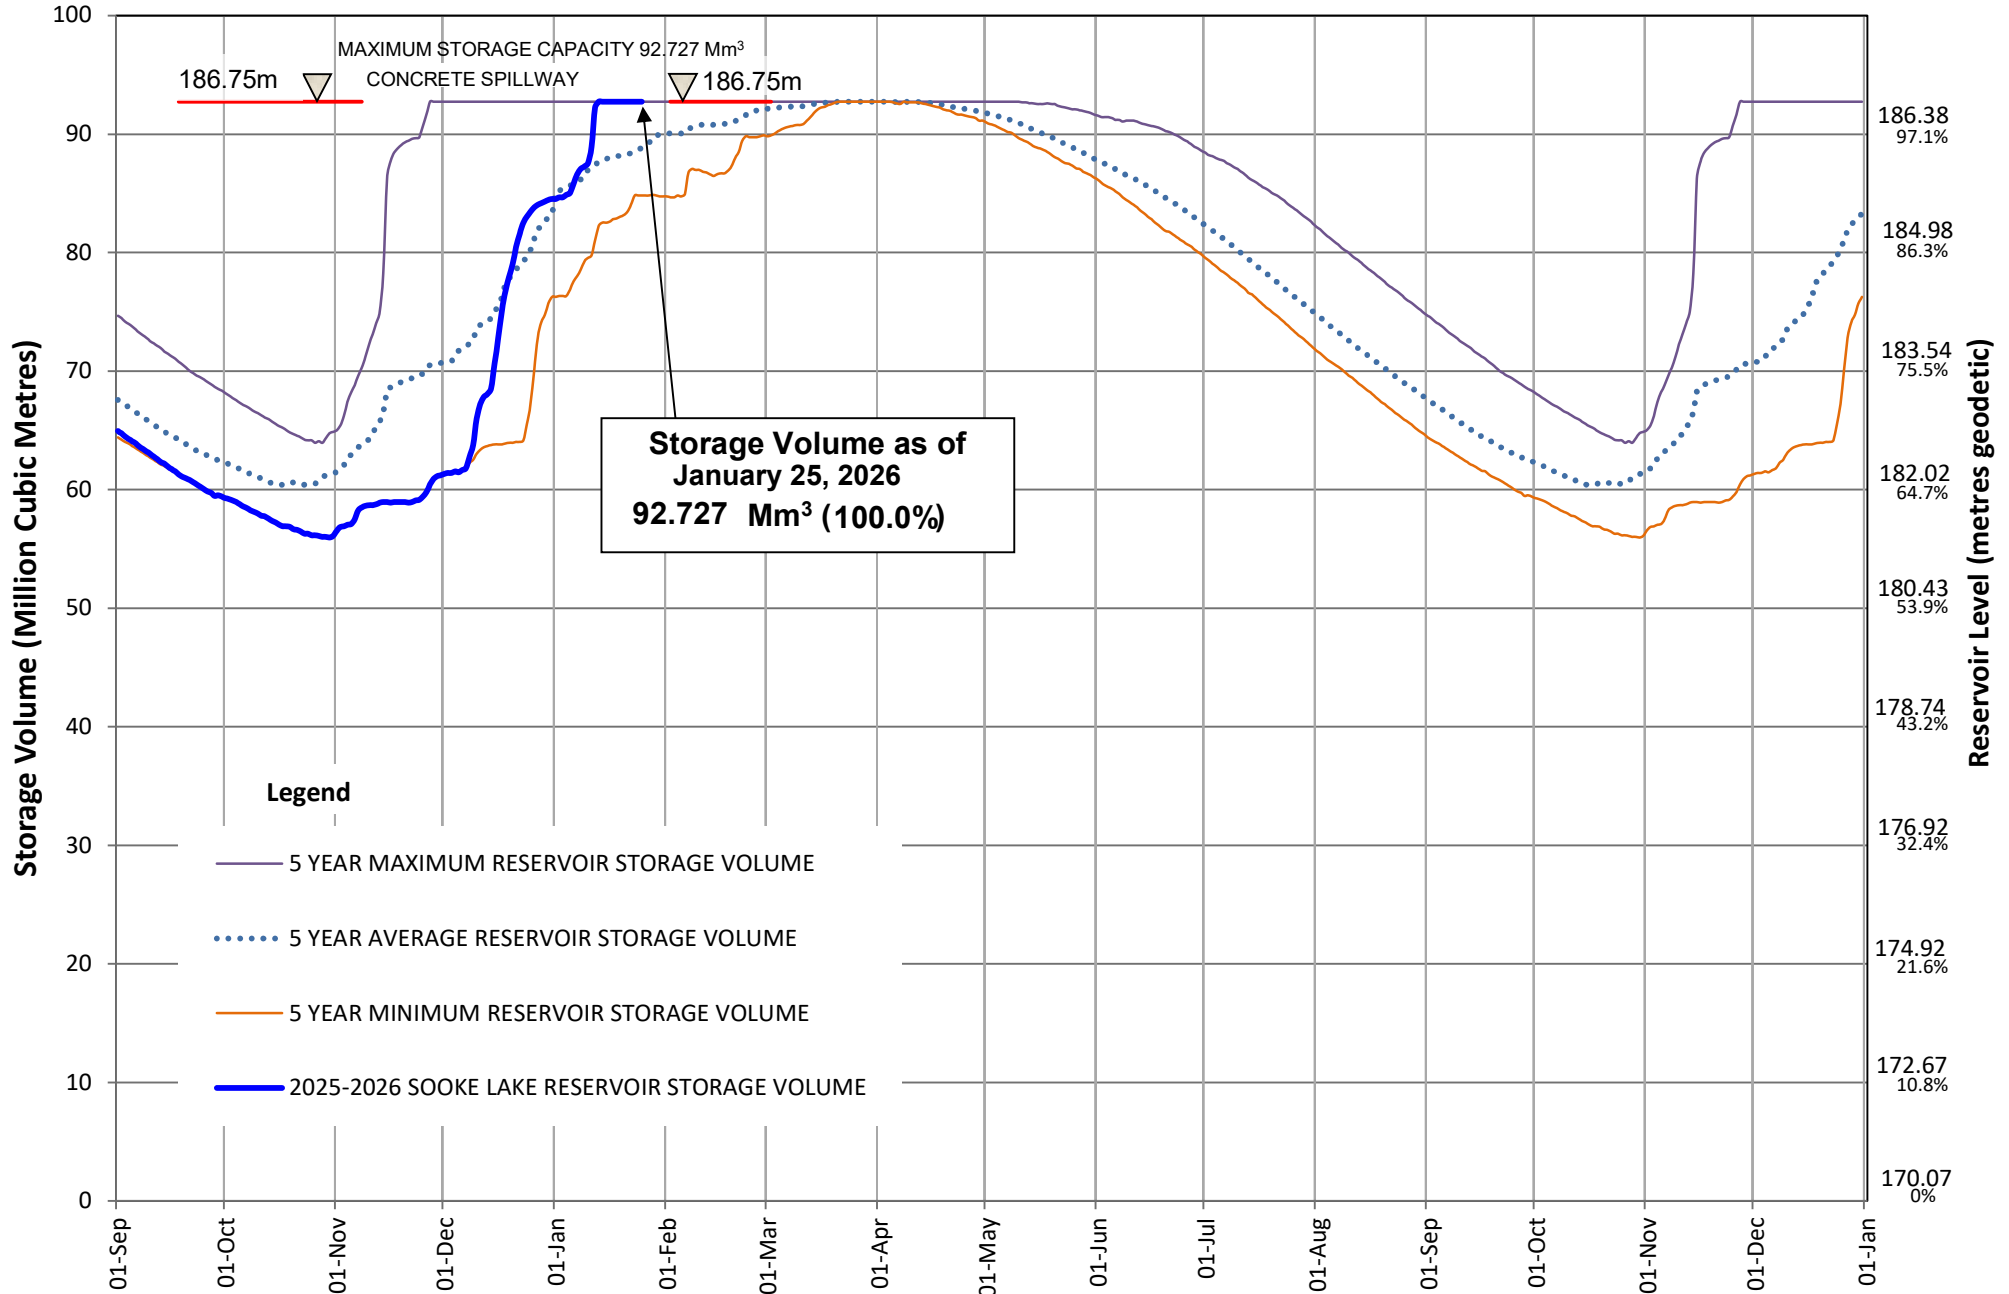

Sooke Lake Reservoir Storage Level

Water Supply Management Plan

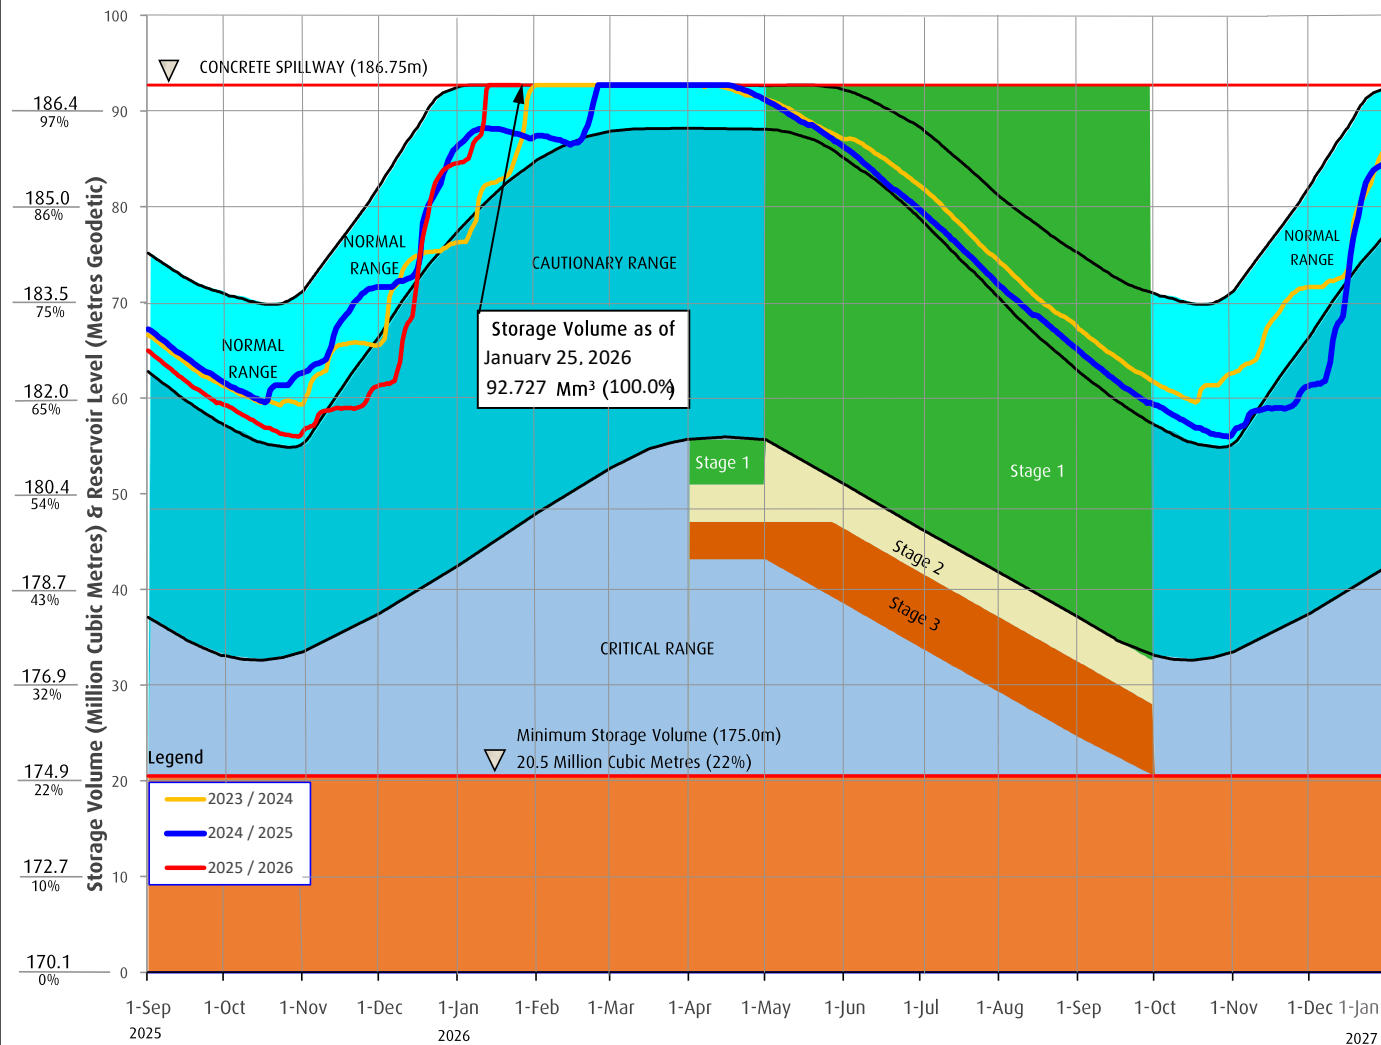

FAQs

How are water restriction stages determined?

Several factors are considered when determining water use restriction stages, including,

1. Time of year and typical seasonal water demand trends;
2. Precipitation and temperature conditions and forecasts;
3. Storage levels and storage volumes of water reservoirs (Sooke Lake Reservoir and the Goldstream Reservoirs) and draw down rates;
4. Stream flows and inflows into Sooke Lake Reservoir;
5. Water usage, recent consumption and trends; and customer compliance with restriction;
6. Water supply system performance.

The Regional Water Supply Commission will consider the above factors in making a determination to implement stage 2 or 3 restrictions, under the Water Conservation Bylaw.

At any time of the year and regardless of the water use restriction storage, customers are encouraged to limit discretionary water use in order to maximize the amount of water in the Regional Water Supply System Reservoirs available for nondiscretionary potable water use.

Stage 1 is normally initiated every year from May 1 to September 30 to manage outdoor use during the summer months. During this time, lawn watering is permitted twice a week at different times for even and odd numbered addresses.

Stage 2 Is initiated when it is determined that there is an acute water supply shortage. During this time, lawn water is permitted once a week at different times for even and odd numbered addresses.

Stage 3 Is initiated when it is determined that there is a severe water supply shortage. During this time, lawn watering is not permitted. Other outdoor water use activities are restricted as well.

For more information, visit www.crd.bc.ca/drinkingwater

CRD
Making a difference...together

Useable Reservoir Volumes in Storage for January 25, 2026

