


McLoughlin Wastewater Treatment Plant TSS and CBOD concentrations (2015 to 2025)

Figure 1 Quarterly (2015-2020) or monthly (2021-2025) average total suspended solids (TSS) and carbonaceous biochemical oxygen demand (CBOD) before and after commissioning of the McLoughlin Point Wastewater Treatment Plant¹. Federal and provincial effluent quality limits are included for comparison.

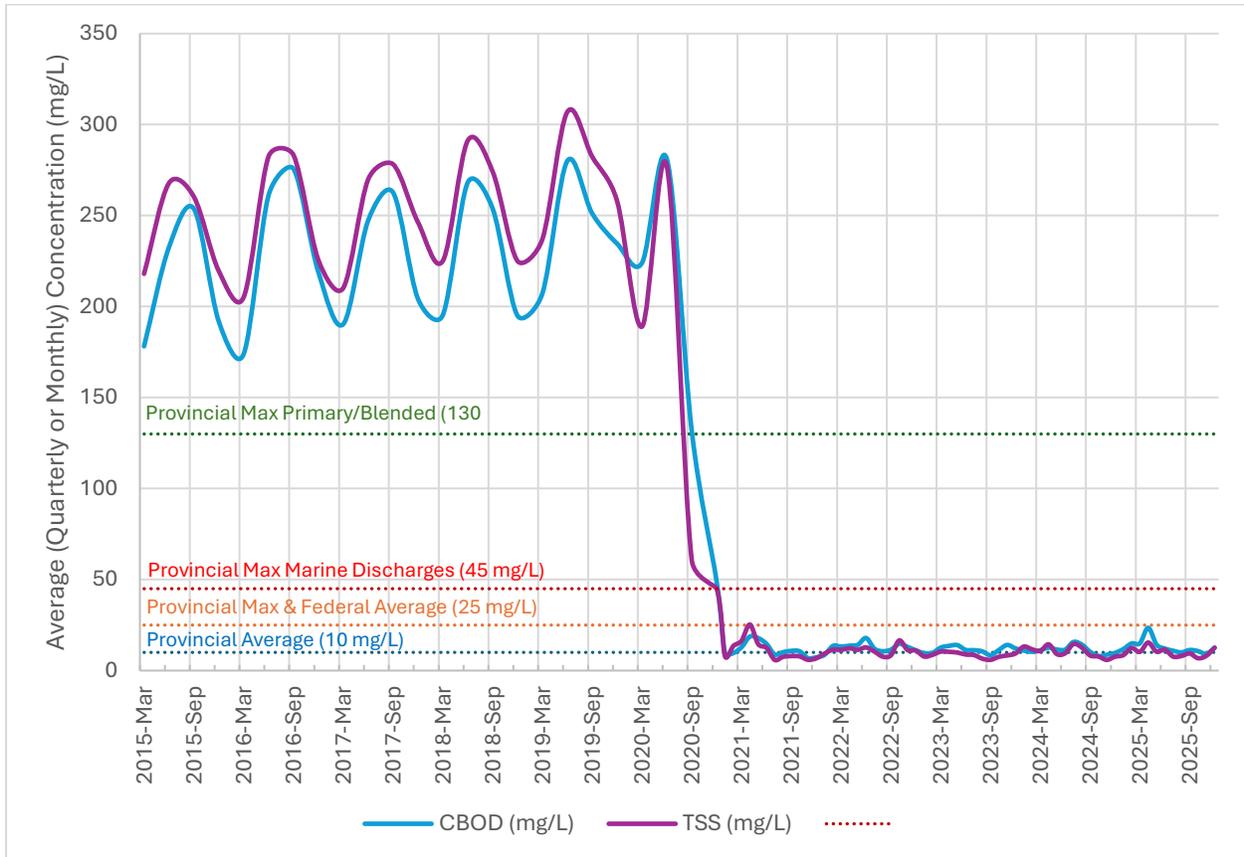

¹ Data pre-August 2020 are from the Macaulay and Clover pumpstations, though no samples were collected April-July 2020 as both pumpstations were inaccessible due to construction. McLoughlin Point WWTP commissioning took place August-December 2020. A planned maintenance bypass occurred March/April 2025.