

CAPITAL REGIONAL DISTRICT - INFRASTRUCTURE & WATER SERVICES

Water Watch

Issued June 08, 2026

Water Supply System Summary:

1. Useable Volume in Storage:

Reservoir	June 30 5 Year Ave		June 30/25		June 7/26		% Existing Full Storage
	ML	MIG	ML	MIG	ML	MIG	
Sooke	82,518	18,154	79,837	17,564	83,813	18,439	90.4%
Goldstream	9,086	1,999	8,928	1,964	9,400	2,068	94.8%
Total	91,604	20,153	88,765	19,528	93,213	20,507	90.8%

2. Average Daily Demand:

For the month of June	192.6 MLD	42.4 MIGD
For week ending June 07, 2026	192.6 MLD	42.4 MIGD
Max. day June 2026, to date:	203.9 MLD	44.9 MIGD

3. Average 5 Year Daily Demand for June

Average (2021 - 2025)	184.1 MLD ¹	40.5 MIGD ²
-----------------------	------------------------	------------------------

¹MLD = Million Litres Per Day ²MIGD = Million Imperial Gallons Per Day

4. Rainfall June:

Average (1914 - 2025):	35.3 mm
Actual Rainfall to Date	4.4 mm (12% of monthly average)

5. Rainfall: Sep 1- Jun 7

Average (1914 - 2025):	1,555.5 mm
2025/2026	1,615.6 mm (104% of average)

6. Water Conservation Required Action:

Did you know that the 2024 change to the Water Conservation Bylaw recommends that landowners and residents switch timing of residential irrigation systems from 4:00 am to an expanded window anytime between 12:01 am to 10:00 am on established watering days? Please go to [Water Conservation Bylaw Changes | Capital Regional District](https://www.crd.ca/news/water-conservation-bylaw-changes) to get informed and do your part to help protect our regional water supply system.

<https://www.crd.ca/news/water-conservation-bylaw-changes>

For general information regarding water conservation, visit the CRD webpage linked below:

<https://www.crd.ca/environment/water-conservation>

7. Get to Know Your H2O Tours

Register for a free tour of the water supply area this May or June.

For more information, please visit webpage linked below:

<https://www.crd.ca/watertours>

If you require further information, please contact:

Alicia Fraser, P. Eng.
 General Manager, CRD - Infrastructure and Water Services
 or
 Glenn Harris, Ph D., RPBio
 Senior Manager - Environmental Protection

CRD Infrastructure & Water Services
 479 Island Highway
 Victoria, BC V9B 1H7
 (250) 474-9600


Daily Consumption

June 2026

Consumption (Million Litres)

Average Daily Consumption = 192.6 M.L.

- 2026 Actual Daily Consumption
- 5 Year Average Daily Consumption for the Month
- 2025 Average Daily Consumption for the Month

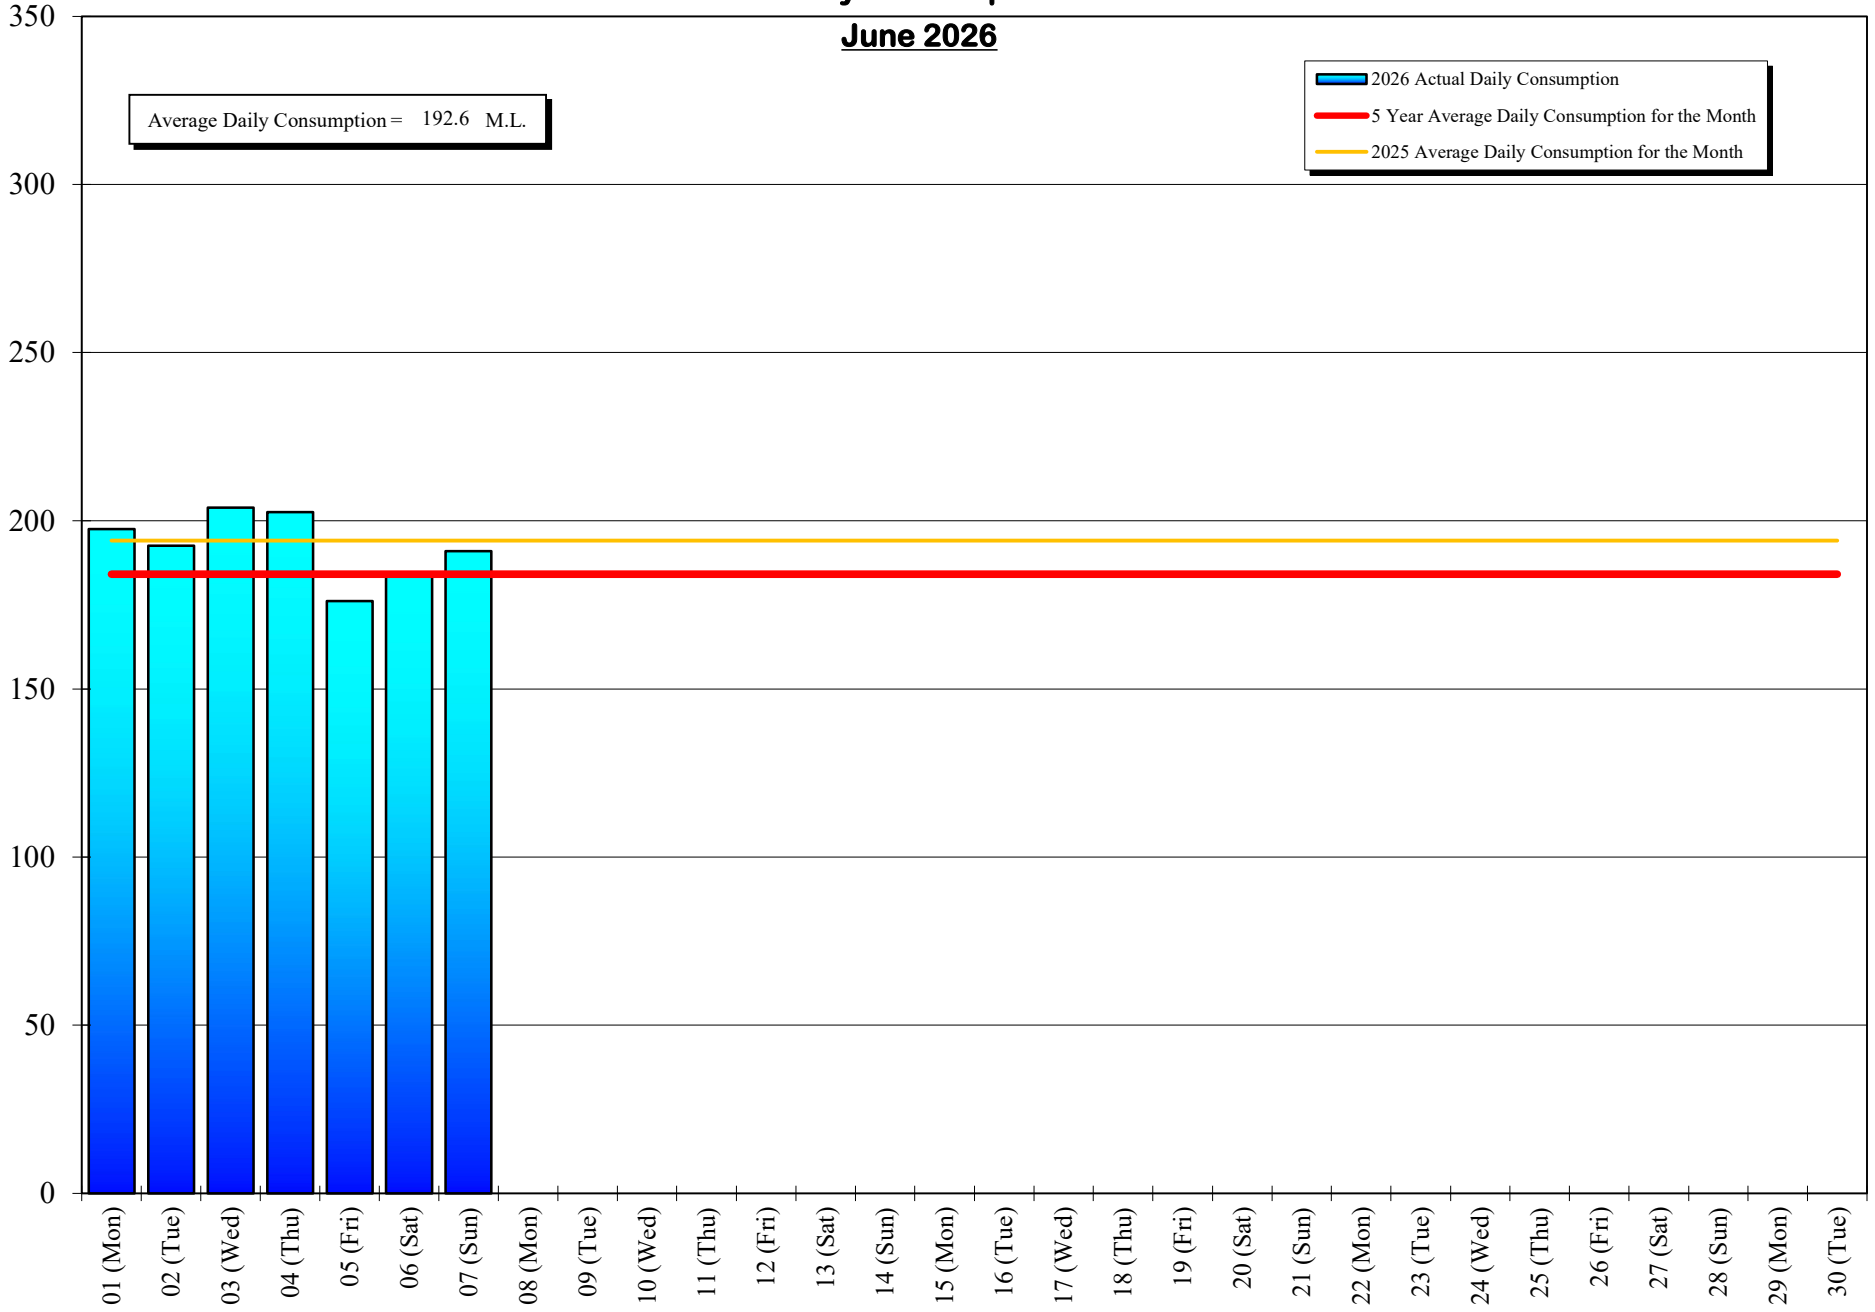

Day

Daily Consumptions: - June 2026

Date	Total Consumption		Air Temperature @ Japan Gulch		Weather Conditions	Precipitation @ Sooke Res.: 12:00am to 12:00am		
	(ML) ¹	(MIG) ²	High (°C)	Low (°C)		Rainfall (mm)	Snowfall ⁷ (mm)	Total Precip.
01 (Mon)	197.5	43.4	26	8	Cloudy, P. Sunny	0.0	0.0	0.0
02 (Tue)	192.6	42.4	28	11	Sunny, P. Cloudy	0.0	0.0	0.0
03 (Wed)	203.9 <=Max	44.9	22	12	Cloudy, Showers	0.0	0.0	0.0
04 (Thu)	202.6	44.6	18	11	P. Sunny	0.0	0.0	0.0
05 (Fri)	176.1 <=Min	38.7	16	9	Cloudy, P. Sunny	0.2	0.0	0.2
06 (Sat)	184.6	40.6	14	7	Cloudy, P. Sunny, Showers	4.2	0.0	4.2
07 (Sun)	191.0	42.0	18	8	Cloudy, P. Sunny	0.0	0.0	0.0
08 (Mon)								
09 (Tue)								
10 (Wed)								
11 (Thu)								
12 (Fri)								
13 (Sat)								
14 (Sun)								
15 (Mon)								
16 (Tue)								
17 (Wed)								
18 (Thu)								
19 (Fri)								
20 (Sat)								
21 (Sun)								
22 (Mon)								
23 (Tue)								
24 (Wed)								
25 (Thu)								
26 (Fri)								
27 (Sat)								
28 (Sun)								
29 (Mon)								
30 (Tue)								
TOTAL	1348.3 ML	296.59 MIG				4.4	0	4.4
MAX	203.9	44.85	28	12		4.2	0	4.2
AVG	192.6	42.37	20.2	9.4		0.6	0	0.6
MIN	176.1	38.73	14	7		0.0	0	0.0

1. ML = Million Litres

2. 10% of snow depth applied to rainfall figures for snow to water equivalent.


Average Rainfall for June (1914-2025)	35.3 mm
Actual Rainfall: June	4.4 mm
% of Average	12%
Average Rainfall (1914-2025): Sept 01 - Jun 07	1,555.5 mm
Actual Rainfall (2025/26): Sept 01 - Jun 07	1,615.6 mm
% of Average	104%

Number days with precip. 0.2 or more
2

Water spilled at Sooke Reservoir to date (since Sept. 1) = 4.26 Billion Imperial Gallons
19.40 Billion Litres


SOOKE LAKE RESERVOIR STORAGE SUMMARY

2025 / 2026

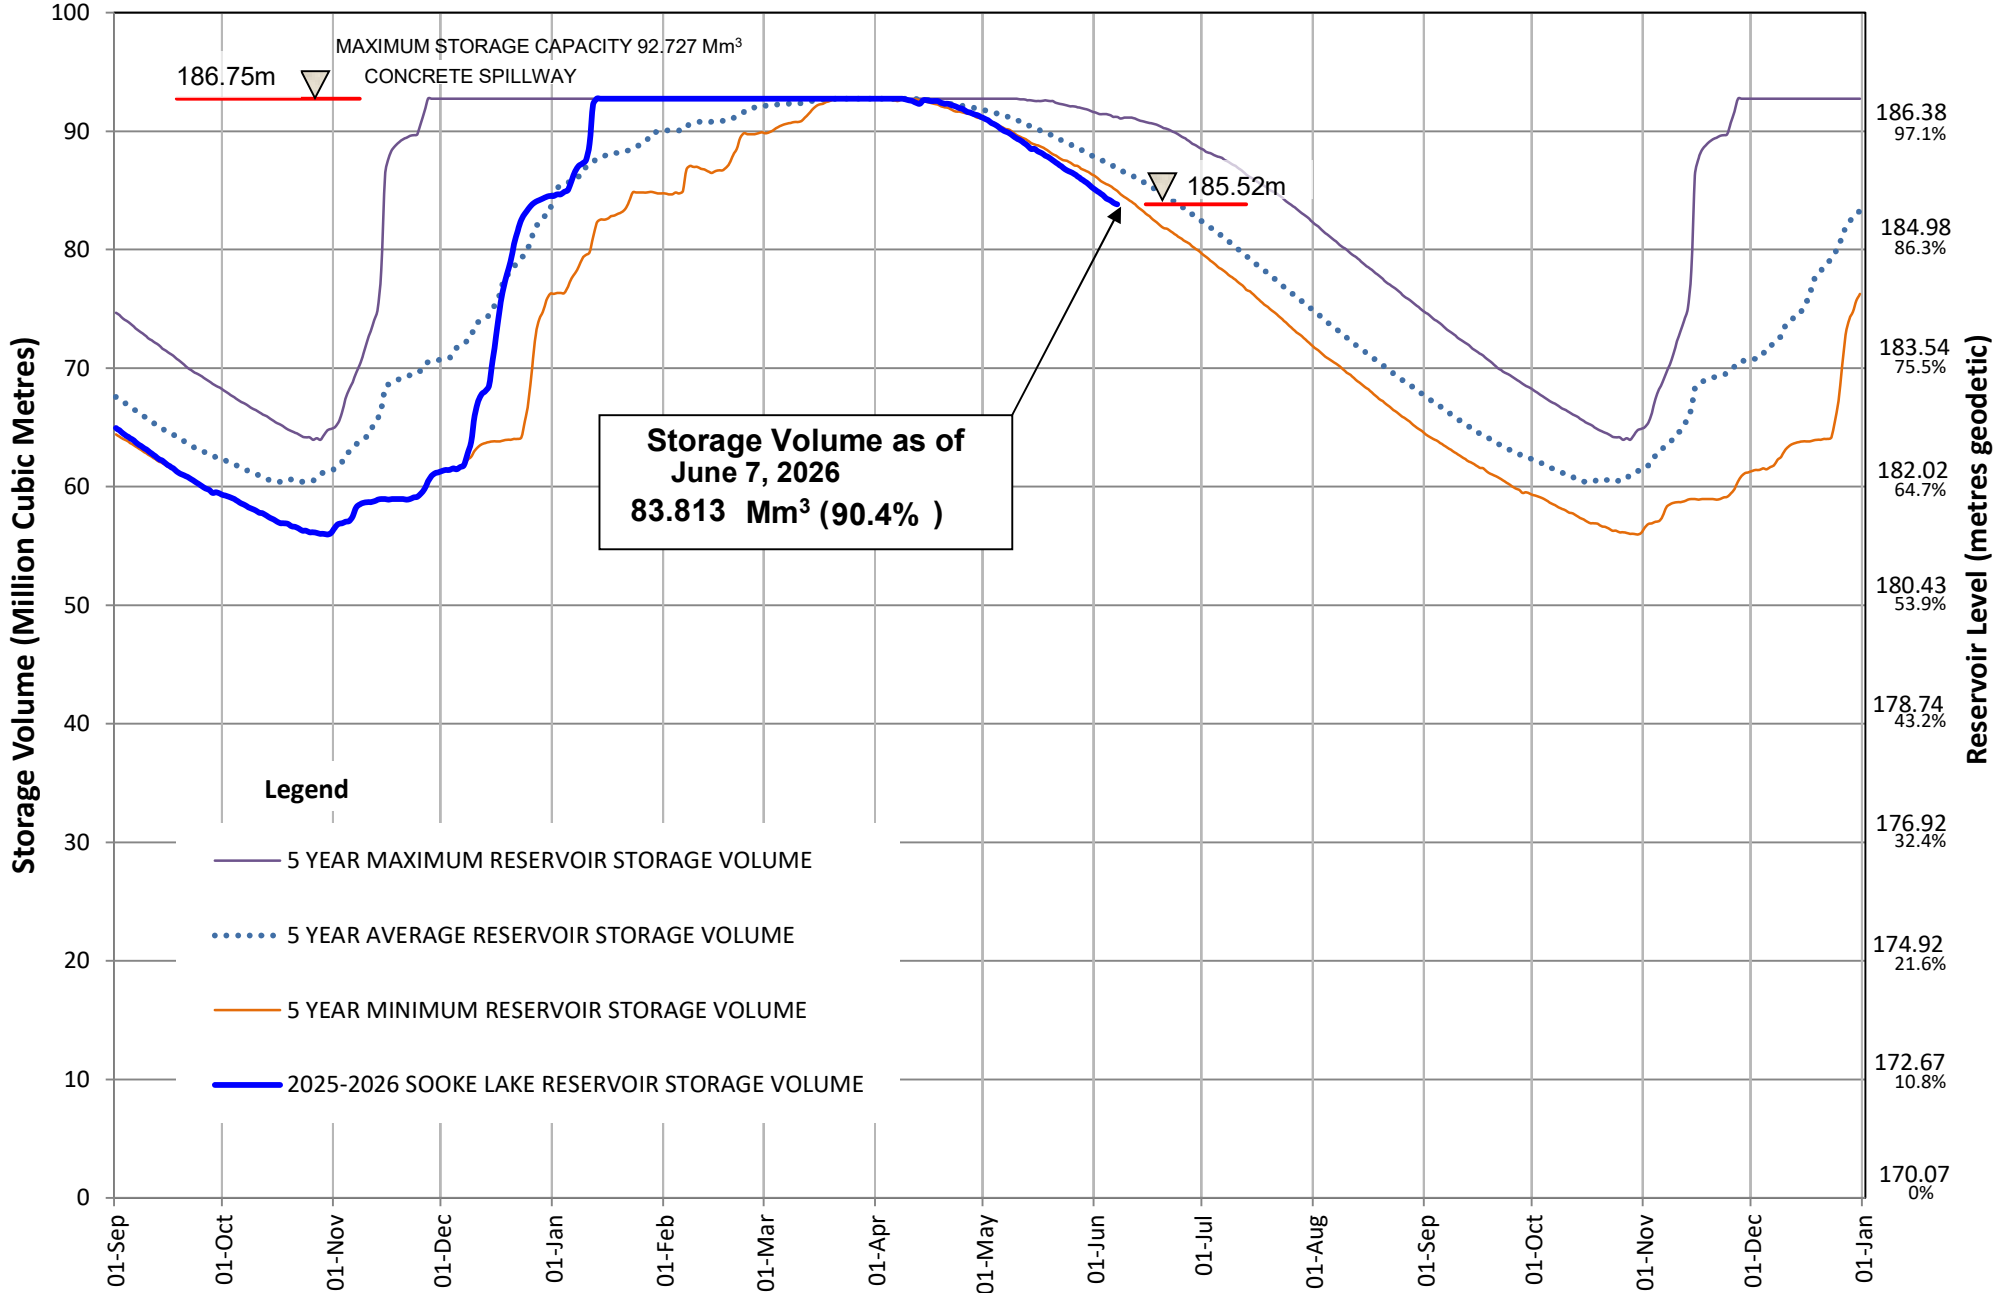

Sooke Lake Reservoir Storage Level

Water Supply Management Plan

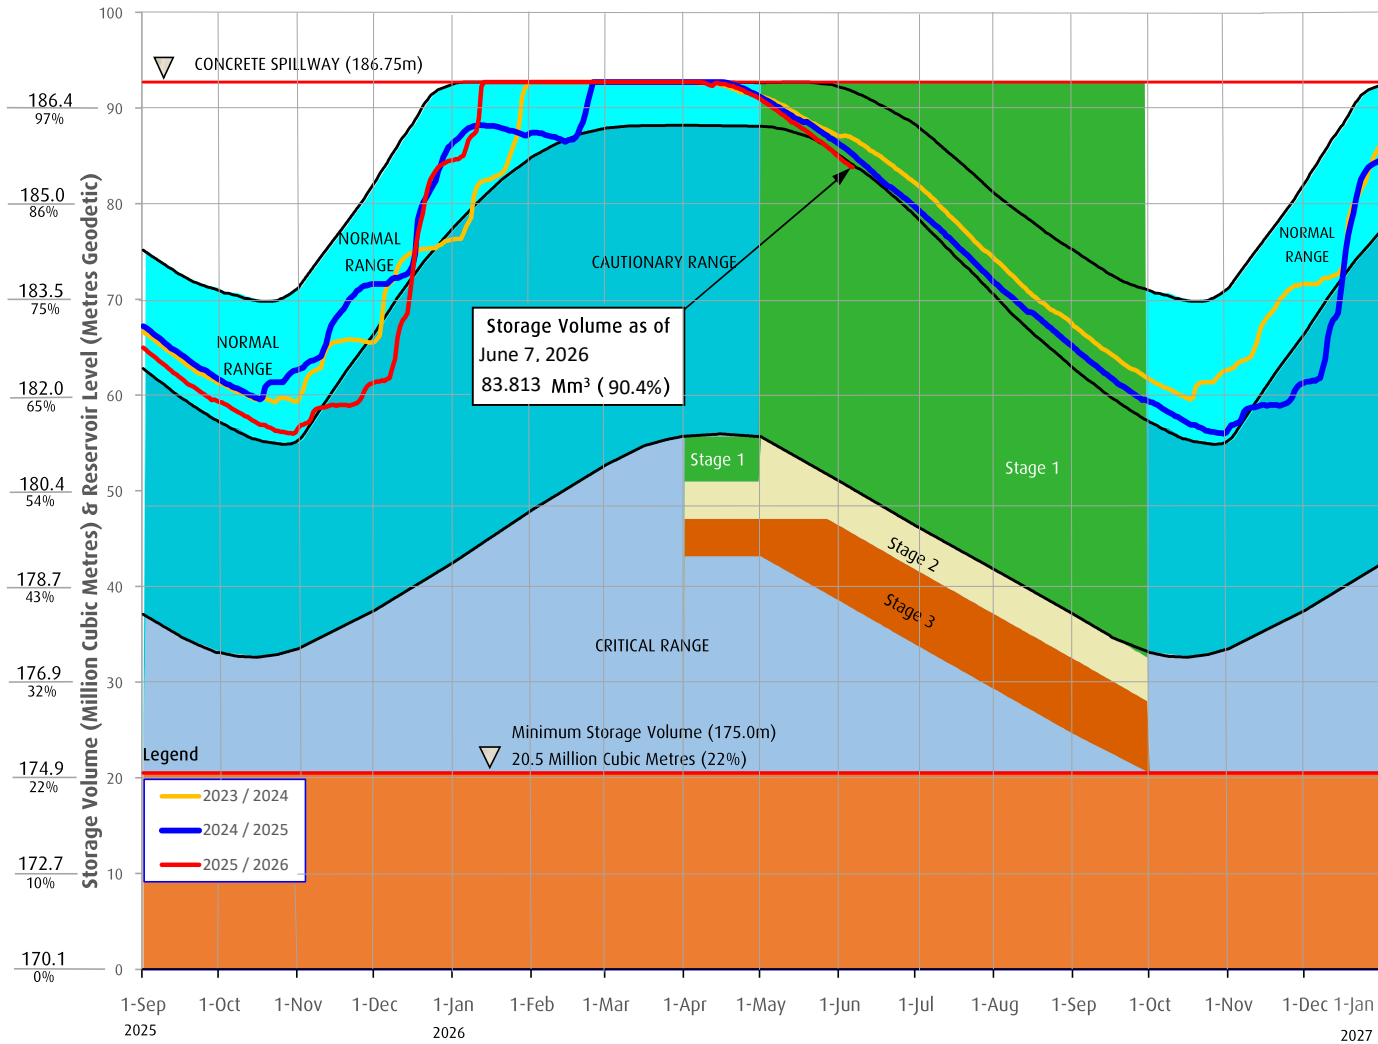

FAQs

How are water restriction stages determined?

Several factors are considered when determining water use restriction stages, including,

1. Time of year and typical seasonal water demand trends;
2. Precipitation and temperature conditions and forecasts;
3. Storage levels and storage volumes of water reservoirs (Sooke Lake Reservoir and the Goldstream Reservoirs) and draw down rates;
4. Stream flows and inflows into Sooke Lake Reservoir;
5. Water usage, recent consumption and trends; and customer compliance with restriction;
6. Water supply system performance.

The Regional Water Supply Commission will consider the above factors in making a determination to implement stage 2 or 3 restrictions, under the Water Conservation Bylaw.

At any time of the year and regardless of the water use restriction storage, customers are encouraged to limit discretionary water use in order to maximize the amount of water in the Regional Water Supply System Reservoirs available for nondiscretionary potable water use.

Stage 1 is normally initiated every year from May 1 to September 30 to manage outdoor use during the summer months. During this time, lawn watering is permitted twice a week at different times for even and odd numbered addresses.

Stage 2 is initiated when it is determined that there is an acute water supply shortage. During this time, lawn water is permitted once a week at different times for even and odd numbered addresses.

Stage 3 is initiated when it is determined that there is a severe water supply shortage. During this time, lawn watering is not permitted. Other outdoor water use activities are restricted as well.

For more information, visit www.crd.bc.ca/drinkingwater

Useable Reservoir Volumes in Storage for June 07, 2026

